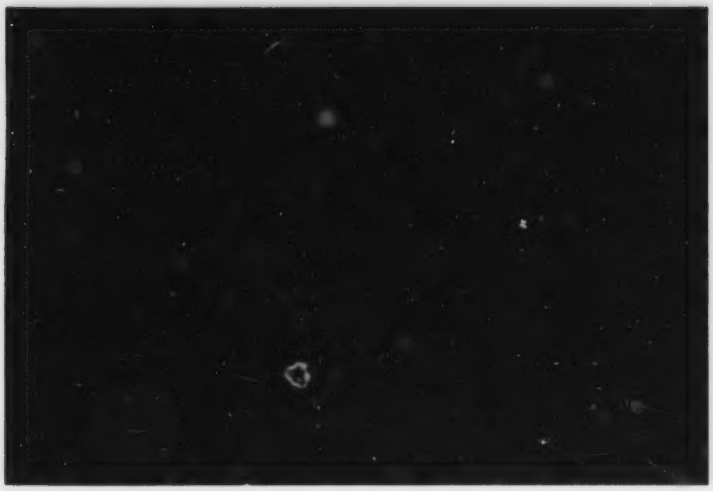

Partners for Health

Manitoba
Health

MG-2688

100-07335/

MANITOBA HEALTH

EXTERNAL PROGRAMS AND OPERATIONS

COMMUNITY WATER FLUORIDATION PROGRAM

1999 / 2000

Prepared by: EnviroTest Laboratories
(Manitoba Technology Centre Ltd.)

in conjunction with
Manitoba Health

TABLE OF CONTENTS

PAGE

INTRODUCTION 1

I. STATUS OF FLUORIDATION IN MANITOBA 2
COMMUNITIES WITH A FLUORIDATED WATER SUPPLY
TABLE I 3/4

II. FLUORIDATION GRANT
A. OVERVIEW 5
B. NEW PARTICIPANTS AND UPGRADES 5

III. EQUIPMENT
A. OVERVIEW 6
B. FLUORIDATION SYSTEMS 6
C. OPERATING PROBLEMS 7

IV. MONITORING PROGRAM
A. OVERVIEW 8
B. RESULTS 9

BI-WEEKLY SAMPLING RESULTS - 1999 / 2000 SUMMARY
TABLE II 10

C. CERTIFICATES 11
1999 / 2000 RECIPIENTS 12

V. INFRASTRUCTURE SERVICES 13

VI. SUPPORT SERVICES 14

VII. FLUORIDE CONTROL DATA - 1999 / 2000 15
(Listed by location of the water treatment plant.)

FLUORIDE CONTROL DATA - 1999 / 2000 SUMMARY - TABLE III 16
FLUORIDE CONTROL DATA KEY 17

ALTONA 18
AUSTIN 19
BALDUR 20
BENITO 21
BINSCARTH 22
BIRTLE 23
BOISSEVAIN 24
BRANDON 25
C.F.B. SHILO 26
CARMAN 27
CHURCHILL 28

TABLE OF CONTENTS (continued) **PAGE**

CRANBERRY PORTAGE....29
CROSS LAKE COMMUNITY....30
CROSS LAKE RESERVE....31
CROSS LAKE SAGGITAWAK....32
DAUPHIN....33
DELORAINE....34
ERICKSON....35
FLIN FLON....36
GILBERT PLAINS....37
GILLAM....38
GIMLI (TOWN)....39
GIMLI INDUSTRIAL PARK....40
GLADSTONE....41
GRISWOLD SIOUX VALLEY BAND....42
HAMIOTA....43
HARTNEY....44
KILLARNEY....45
LAC DU BONNET....46
LETELLIER....47
LONG PLAIN....48
MCCREARY....49
MANITOU....50
MELITA....51
MINNEDOSA....52
MORDEN....53
MORRIS....54
NEEPAWA....55
NORWAY HOUSE COMMUNITY COUNCIL....56
NORWAY HOUSE CREE NATION....57
PILOT MOUND....58
PINAWA....59
PORTAGE LA PRAIRIE....60
RESTON....61
RIVERS....62
ROBLIN....63
ROSSBURN....64
RUSSELL....65
ST. CLAUDE....66
STE. ROSE DU LAC....67
SANDY BAY RESERVE....68
SANFORD....69
SHOAL LAKE....70
SNOW LAKE....71
SOURIS....72
STEINBACH....73
STEPHENFIELD....74
SWAN RIVER....75
THE PAS....76
TREHERNE....77
VIRDEN....78
WABOWDEN....79
WINKLER....80
WINNIPEG....81
WINNIPEGOSIS....82

INTRODUCTION

This report is a brief summary of the performance of Manitoba Health's Community Water Fluoridation Program for the 1999 / 2000 fiscal year.

I. STATUS OF FLUORIDATION IN MANITOBA - 1999/2000

A total of sixty-five (65) water treatment plants provide fluoridated water to approximately eighty-six (86) communities. Approximately 95% of the population served by a public water system receive fluoridated water. Population statistics are based on the 1996 census figures unless otherwise indicated. Included in the above statistics are an estimated number of rural residents who consume water transported from a fluoridated water supply.

Manitoba Health operates a province-wide fluoride level monitoring program for all fluoridating communities. All 65 water treatment plants participated in the monitoring program.

Manitoba Health offers a grant for communities wishing to install a fluoridation system in their communal water system. Assistance is provided in the design and selection of suitable fluoridation systems/equipment.

Training in equipment operation and maintenance, testing procedures, safety standards and monitoring protocol is provided initially to all communities. Technical assistance and support is then provided on an ongoing basis.

MANITOBA HEALTH
SUMMARY

PROVINCE OF MANITOBA

TABLE 1

COMMUNITIES WITH A FLUORIDATED WATER SUPPLY AS OF APRIL 1, 1999

NOTE: POPULATION STATISTICS ARE FROM 1996 CENSUS EXCEPT FOR THOSE INDICATED BY ** WHICH ARE STILL 1991 FIGURES, AND BY *** WHICH ARE 1986 FIGURES.

WATER PLANT LOCATION	STATUS	POP. 1996 CENSUS	MINISTERIAL APPROVAL	DATES ON LINE	BACK-GROUND LEVEL	TYPE OF CHEMICAL FEED	AVERAGE [F] p.p.m. 1999/2000	WATER SOURCE	WATER PLANT OWNER
ALTONA	Town	3,286	66 09 19	N/A	0.29	H_2SiF_6	1.06	RIVER	MWSB
AUSTIN	Region	1,279***	N/A	88 12 15	0.19	NaF 4%	1.05	RIVER	RM
BALDUR	Village	341**	66 09 19	67 11 15	0.22	NaF 4%	0.83	WELL	MWSB
BENITO	Village	460	N/A	91 08 00	0.30	NaF 4%	1.03	RIVER	MWSB
BINSCARTH	Village	463	94 11 01	95 07 19	0.24	H_2SiF_6	0.77	WELL	VILLAGE
BIRTLE	Town	720	89 05 04	87 11 07	0.26	H_2SiF_6	1.08	WELL	TOWN
BOISSEVAIN	Town	1,544	56 11 05	57 01 11	0.20	NaF 4%	0.90	SI	TOWN
BRANDON	City	39,175	53 08 11	55 03 08	0.20	Na_2SiF_6	0.96	RIVER	CITY
CARMAN	Town	2,704	65 06 22	65 11 03	0.21	H_2SiF_6	0.85	RIVER	TOWN
CHURCHILL	LGD	1,089	94 11 01	95 10 04	<0.10	H_2SiF_6	0.77	RIVER	LGD
CRAN. PORTAGE	UVD	723	83 03 19	83 12 14	<0.10	NaF 4%	1.25	LAKE	MWSB
CROSS LAKE	Comm.	4,000 ◊	N/A	92 06 27	<0.10	NaF 4%	N/A	RIVER	COMM
CROSS LAKE	Reserve	4,000 ◊	N/A	92 05 02	<0.10	NaF 4%	1.03	RIVER	RSVE
CROSS LAKE SAG	Reserve	4,000 ◊	N/A	93 06 15	<0.10	NaF 4%	0.90	RIVER	RSVE
DAUPHIN	Town	8,226	57 08 02	80 05 03	0.14	H_2SiF_6	0.91	SI	TOWN
DELORAINE	Town	1,041	67 07 28	68 09 24	0.16	NaF 4%	0.77	SI	MWSB
ERICKSON	Village	507	72 10 12	73 05 04	0.23	NaF 4%	0.97	WELL	MWSB
FLIN FLON	City	6,572	61 07 01	89 12 15	<0.10	H_2SiF_6	0.97	LAKE	CITY
GILBERT PLAINS	Village	748	N/A	89 02 22	0.19	NaF 4%	0.81	WELL	VILL
GILLAM	LGD	1,534	74 08 14	87 01 03	<0.10	H_2SiF_6	1.08	RIVER	LGD
GIMLI	RM	3,124	87 05 00	69 04 18	0.43	NaF 4%	0.96	WELL	RM
GIMLI	Town	1,574	63 08 01	63 12 23	0.45	NaF 4%	0.99	WELL	TOWN
GLADSTONE	Town	927	71 04 19	76 09 23	0.22	NaF 4%	1.02	RIVER	TOWN
GRISWOLD	Reserve	1136	99 11	99 11 26	0.10	NaF 4%	4.78	WELL	RESERVE
SIOUX VALLEY									
HAMIOTA	Village	847	70 05 27	70 08 17	0.29	NaF 4%	0.98	WELL	MWSB
HARTNEY	Town	462	64 01 02	64 12 16	0.20	NaF 4%	0.97	WELL	TOWN
KILLARNEY	Town	2,208	60 10 12	60 10 25	0.19	NaF 4%	1.88	LAKE	TOWN
LAC DU BONNET	Village	1,070	89 05 04	85 09 00	<0.10	NaF 4%	0.98	WELL	VILL
LETELLIER	Region	3,921**	89 05 04	87 05 13	0.17	H_2SiF_6	1.05	RIVER	MWSB
LONG PLAIN	Reserve	597	N/A	94 03 02	0.23	NaF 4%	1.13	WELL	RSVE
MANITOU	Village	781	64 01 21	65 05 13	0.19	NaF 4%	1.03	SI	MWSB

NOTES:

The Red River Regional Water Treatment Plant in Letellier, Manitoba serves the following communities: Altona Rural Water Co-op, Dominion City, Gnadenfeld, Gnadenthal, Halbstadt - Marais Water Co-op, Hordean, Letellier, New Bercthal, Plum Coulee, Rosenfeld, Rosseau River Reserve and Sommerfeld and St. Jean.

The town of Altona receives a blend of water from the Regional Plant in Letellier and the water treatment plant in Neche, North Dakota, USA. Altona is a sampling location only.

The Village of MacGregor (Population 898 - 1996) began receiving water from the Austin-MacGregor Regional Treatment Plant in December/1989.

◊ Cross Lake Community and Cross Lake Reserves combined have an approximate total population of 4000.

KEY:

1. Status
   - CFB - Canadian Forces Base
   - LGD - Local Government District
   - RM - Rural Municipality
   - UVD - Unincorporated Village District

2. Type of Chemical Feed
   - H_2SiF_6 - Fluorosilicic Acid
   - NaF - Sodium Fluoride
   - Na_2SiF_6 - Sodium Fluorosilicate (Dry)

3. Water Plant Owner
   - CFB - Canadian Forces Base
   - LGD - Local Government District
   - MWSB - Manitoba Water Services Board
   - RM - Rural Municipality
   - PVWC – Pembina Valley Water Co-Op

4. Water Source
   - SI - Surface Impoundment

TABLE I

(continued)

MANITOBA HEALTH
SUMMARY

COMMUNITIES WITH A FLUORIDATED WATER SUPPLY AS OF APRIL 1, 1999

NOTE: POPULATION STATISTICS ARE FROM 1996 CENSUS EXCEPT FOR THOSE INDICATED BY ** WHICH ARE STILL 1991 FIGURES, AND BY *** WHICH ARE 1986 FIGURES.

WATER PLANT LOCATION	STATUS	POP. 1996 CENSUS	MINISTERIAL APPROVAL	DATES ON LINE	BACK-GROUND LEVEL	TYPE OF CHEMICAL FEED	AVERAGE [F] p.p.m. 1999/2000	WATER SOURCE	WATER PLANT OWNER
McCREARY	Village	537	69 08 28	69 11 18	0.24	NaF 4%	0.85	WELL	MWSB
MELITA	Town	1,152	89 05 04	87 02 14	0.18	NaF 4%	0.95	WELL	TOWN
MINNEDOSA	Town	2,443	60 01 25	86 04 00	0.28	H_2SiF_6	1.07	WELL	TOWN
MORDEN	Town	5,689	68 09 09	69 11 17	0.32	H_2SiF_6	0.93	LAKE	TOWN
MORRIS	Town	1,645	89 05 04	89 02 27	0.22	H_2SiF_6	0.98	RIVER	TOWN
NEEPAWA	Town	3,301	63 06 10	63 07 10	0.24	Na_2SiF_6	0.85	LAKE	TOWN
NH CMNTY COUN.	Town	2,100**	95 01 00	95 09/00	0.21	H_2SiF_6	0.99	RIVER	TOWN
NH FIRST NATION	Reserve	3,000**	95 01 00	95 09 00	<.01	H_2SiF_6	N/A	RIVER	BAND
PILOT MOUND	Village	716	68 10 25	70 12 21	0.21	NaF 4%	0.94	SI	MWSB
PINAWA	LGD	1,672	63 11 26	64 01 14	0.08	H_2SiF_6	0.94	RIVER	LGD
PORTAGE LA PRAIRIE	City	13,077	57 12 20	58 01 13	0.20	H_2SiF_6	0.97	RIVER	CITY
RESTON	Village	620**	67 09 13	68 11 26	0.13	NaF 4%	0.96	WELL	MWSB
RIVERS	Town	1,117	68 06 07	86 10 27	0.18	NaF 4%	1.08	WELL	TOWN
ROBLIN	Town	1,885	69 06 07	86 10 27	0.26	NaF 4%	0.99	WELL	TOWN
ROSSBURN	Village	580	89 05 04	77 12 05	0.10	NaF 4%	1.00	WELL	MWSB
RUSSELL	Town	1,605	65 09 10	67 03 01	0.21	NaF 4%	0.94	WELL	MWSB
ST. CLAUDE	Village	609	92 09 02	93 04 04	0.45	NaF 4%	0.94	WELL	VILL
STE. ROSE DU LAC	Village	1,047	69 11 25	87 10 24	0.12	NaF 4%	0.67	WELL	MWSB
SANFORD	Region	1,657***	N/A	89 11 21	0.10	H_2SiF_6	1.08	RIVER	RM
SANDY BAY	Reserve	2,227	N/A	89 01 28	0.22	NaF 4%	N/A	WELL	RSVE
SHILO	CFB	3,200***	N/A	69 01 14	0.05	NaF 4%	0.85	WELL	CFB
SHOAL LAKE	Village	801	68 08 26	87 03 28	0.27	NaF 4%	1.55	WELL	VILL
SNOW LAKE	Town	1,310	89 04 00	91 05 00	0.10	H_2SiF_6	0.93	LAKE	TOWN
SOURIS	Town	1,613	62 07 11	63 11 05	0.19	NaF 4%	0.86	RIVER	TOWN
SPLIT LAKE	Reserve	1,500	98 11	98 10	<0.1	NaF 4%	N/A	RIVER	RSVE
STEINBACH	Town	8,478	59 11 04	60 05 23	0.39	H_2SiF_6	1.05	WELL	TOWN
STEPHENFIELD	Region	800	98 12	99 02	0.2	H_2SiF_6	0.87	RIVER	PVWC
SWAN RIVER	Town	3,986	80 10 07	82 08 08	0.18	H_2SiF_6	0.98	WELL	TOWN
THE PAS	Town	5,945	64 07 20	64 07 23	0.15	H_2SiF_6	0.97	RIVER	TOWN
TREHERNE	Village	675	72 11 10	73 06 11	0.32	NaF 4%	1.02	WELL	VILL
VIRDEN	Town	2,956	71 01 11	71 04 08	0.44	NaF 4%	1.03	WELL	TOWN
WABOWDEN	Village	700**	N/A	89 06 30	<0.10	H_2SiF_6	0.87	LAKE	UVD
WINKLER	Town	7,241	64 01 21	64 06 24	0.26	H_2SiF_6	1.02	WELL	TOWN
WINNIPEG	City	618,477	56 07 20	56 12 28	0.10	H_2SiF_6	0.93	LAKE	CITY
WINNIPEGOSIS	Village	730	89 05 04	88 08 10	0.15	NaF 4%	1.27	WELL	MWSB
*OTHER		1,148***							

NOTES:
The Regional Plant in Sanford also serves the communities of Domain, LaSalle, Oakbluff and Starbuck.

*OTHER - The water treatment plant in Neche, North Dakota serves the following communities: Altona, Blumenort, Gretna, Kronstall, Neuhorst, and Rosetown.

KEY:

1. Status
   CFB - Canadian Forces Base
   LGD - Local Government District
   RM - Rural Municipality
   UVD - Unincorporated Village District

2. Type of Chemical Feed
   H_2SiF_6 - Fluorosilicic Acid
   NaF - Sodium Fluoride
   Na_2SiF_6 - Sodium Fluorosilicate (Dry)

3. Water Plant Owner
   CFB - Canadian Forces Base
   LGD - Local Government District
   MWSB - Manitoba Water Services Board
   RM - Rural Municipality
   PVWC – Pembina Valley Water Co-Op

4. Water Source
   SI - Surface Impoundment

II. FLUORIDATION GRANT

Each fiscal year, grant monies are available through Manitoba Health. The grant is a one time award to communities initiating a fluoridation system.

A. OVERVIEW

1) OBJECTIVE:
To have all communal water systems in the Province fluoridated.

2) ELIGIBILITY:
Any community with an existing water treatment plant that currently does not have an optimal fluoride level in the water supply is eligible.

3) DESCRIPTION:
If a community is interested in this grant, contact can be made with Manitoba Health. Manitoba Health will provide information on the grant program, make formal contact with the community and assist in the design, installation and operation of the equipment. Once the system is operational, payment will be authorized to the community for the initial purchase and installation of the equipment. Assistance is provided with ongoing monitoring of the fluoride levels in the water supply.

4) FUNDING:
The grant is based on actual initial costs of purchase and installation of equipment as submitted by communities.

5) MINISTERIAL APPROVAL:
Approval is issued by the Minister of Health to communities operating fluoridation systems in accordance with the regulations under the Manitoba Public Health Act.

B. NEW PARTICIPANTS AND UPGRADES

1) Negotiations pending with St.Theresa Point and Cartier Regional Plant.

2) Several Communities received monies to upgrade old systems.

3) A new system was installed at Griswold Sioux Valley (November 1999).

4) A new system is on line in The Pas (reserve) as of May 2000.

5) Sandy Bay reserve is on line as of spring 2000.

III. EQUIPMENT

Fluoridation systems are periodically monitored and reassessed for efficiency. Efforts are made to upgrade older equipment to more efficient systems.

A. OVERVIEW

Water treatment plants are visited on a periodic basis for the purpose of encouraging preventive maintenance of the fluoridation systems.

Ongoing assistance is provided to ensure that adequate maintenance and safety practices are being followed. Testing procedures are also reviewed to ensure accurate monitoring of fluoride levels.

B. FLUORIDATION SYSTEMS

There are four types of fluoridation systems available. They are as follows:

a) Acid Feed

This system utilizes fluorosilicic acid (H_2SiF_6) as the chemical feed. As of the end of the 1999 / 2000 year, there were 25 acid feed systems in operation in Manitoba.

b) Batch Mix

This system utilizes sodium fluoride (NaF) as the chemical feed. This system is labour intensive and communities utilizing this system are encouraged to upgrade to either an acid feed or an upflow saturator system.

c) Dry Feed

This system utilizes sodium fluorosilicate (Na_2SiF_6) as the chemical feed. There are 3 systems currently in operation. These systems were designed and installed in the 1950's and 1960's for larger treatment facilities. All remaining are fully functional with few operating problems.

d) Upflow Saturator

This system utilizes sodium fluoride (NaF) in a 4% solution as the chemical feed. There are currently 38 systems in operation in Manitoba.

C. OPERATING PROBLEMS

Temporary operating problems may occur from time to time and are usually related to one of the following:

a) obsolete or malfunctioning fluoride feed equipment
b) obsolete or defective testing equipment
c) incorrect testing procedures
d) equipment breakdown
e) improper maintenance
f) changeover to a new system

Occasionally, fluoridation problems are related to water plant problems which are rectified when the plant's problems are corrected.

IV. MONITORING PROGRAM

A. OVERVIEW

The purpose of this program is to ensure that the recommended level for fluoride concentration is maintained in Manitoba's drinking water. All sixty-six (66) water treatment plants participated.

1) Operating Parameters
Manitoba Health identifies an operating range and an optimum level for fluoride concentration in drinking water. The optimum is 1 part per million (p.p.m.) or 1 milligram per litre (mg/l). The operating range for 1999 / 2000 was set at 0.80 p.p.m. as a minimum with 1.20 p.p.m. as a maximum.

Water treatment plant operators are encouraged to maintain fluoride concentrations within the specified range.

Manitoba Health provides a schedule for bi-weekly monitoring periods. A sampling year consists of 26 periods.

2) Supplies
Manitoba Health provides Fluoridation Control Record forms to the plants, to be submitted with the samples.

Manitoba Health also provides sampling bottles, fluoride standard solution, spadns (reagent) and shipping containers to the plants, through the EnviroTest Laboratories. All are necessary for daily testing and bi-weekly sample submission.

3) Sample Submission
Samples are collected on a daily basis, tested on-site and results are recorded by the water treatment plant operator. A 14 day composite sample (approximately one litre) is submitted bi-weekly by the community for analysis. A record of chemical feed data (Fluoridation Control Record) is submitted with the sample.

4) Analysis
The EnviroTest Laboratories located in Winnipeg, receives the samples and conducts the analysis. The results are reported to the individual water treatment plant operators and to Manitoba Health.

5) Monitoring
Manitoba Health monitors the levels, makes recommendations, and provides technical assistance accordingly.

6) Reporting
Communities receive an annual report of their plant's operating record. On a periodic and/or as required basis, reports are provided during the operating year.

B. RESULTS

In 1999 / 2000, out of a possible 1,571 samples, 1,527 bi-weekly samples were received for a submission rate of 97%.

Of the total submitted 1,306 or 86% were within the recommended range for fluoride concentration.

The number of samples found to be above the range was 82, representing 6% of the total.

There were 139 samples found to be below the range representing 8% of all samples submitted.

BI-WEEKLY SAMPLING RESULTS - 1999/2000 - SUMMARY **TABLE II**

TOWN	NUMBER OF SAMPLES WITHIN LIMITS	NUMBER OF SAMPLES ABOVE LIMITS	NUMBER OF SAMPLES BELOW LIMITS	NUMBER OF SAMPLES SUBMITTED	NUMBER OF SAMPLES POSSIBLE
ALTONA	23	0	0	23	26
AUSTIN	23	3	0	26	26
BALDUR	19	0	7	26	26
BENITO	26	0	0	26	26
BINSCARTH	18	0	8	26	26
BIRTLE	15	8	3	26	26
BOISSEVAIN	24	0	2	26	26
BRANDON	25	0	1	26	26
CARMAN	16	1	9	26	26
CFB SHILO	20	0	6	26	26
CHURCHILL	15	0	11	26	26
CRANBERRY PORTAGE	22	3	1	26	26
CROSS LAKE COMM.	-	-	-	-	-
CROSS LAKE RESERVE	26	0	0	26	26
CROSS LAKE SAGG.	22	0	4	26	26
DAUPHIN	23	0	3	26	26
DELORAINE	16	0	10	26	26
ERICKSON	25	1	0	26	26
FLIN FLON	25	0	0	25	26
GILBERT PLAINS	8	4	13	25	26
GILLAM	21	3	2	26	26
GIMLI IND. PARK	25	0	1	26	26
GIMLI (TOWN)	18	0	1	19	26
GLADSTONE	24	2	0	26	26
GRISWOLD SIOUX VALLEY	4	1	3	8	9
HAMIOTA	22	1	2	25	26
HARTNEY	25	0	1	26	26
KILLARNEY	2	24	0	26	26
LAC DU BONNET	21	1	3	25	26
LETELLIER	26	0	0	26	26
LONG PLAIN	20	5	0	25	26
MANITOU	26	0	0	26	26
MELITA	24	1	1	26	26
MINNEDOSA	16	4	2	22	26
MORDEN	25	0	1	26	26
MORRIS	24	2	0	26	26
MCCREARY	23	0	2	25	26
NORWAY HOUSE COMM	22	2	2	26	26
NORWAY HOUSE CREE	-	-	-	-	-
NEEPAWA	20	0	5	25	26
PILOT MOUND	21	1	3	25	26
PINAWA	26	0	0	26	26
PORTAGE LA PRAIRIE	25	0	1	26	26
RESTON	26	0	0	26	26
RIVERS	24	2	0	26	26
ROBLIN	26	0	0	26	26
ROSSBURN	21	3	1	25	26
RUSSELL	24	1	0	25	26
ST. CLAUDE	25	0	0	25	26
STE. ROSE DU LAC	10	0	13	23	26
SANDY BAY	-	-	-	-	-
SANFORD	26	0	0	26	26
SHOAL LAKE	0	1	1	2	26
SNOW LAKE	24	0	1	25	26
SOURIS	24	0	2	26	26
STEINBACH	26	0	0	26	26
STEPHENFIELD	19	0	6	25	26
SWAN RIVER	25	1	0	26	26
THE PAS	26	0	0	26	26
TREHERNE	25	1	0	26	26
VIRDEN	23	2	1	26	26
WABOWDEN	20	0	6	26	26
WINKLER	25	1	0	26	26
WINNIPEG	26	0	0	26	26
WINNIPEGOSIS	10	3	0	13	26

C. CERTIFICATES

Manitoba Health annually presents certificates to recognize water treatment plant operators who have maintained a high standard of operating efficiency for a fluoridation system.

To be eligible for a certificate, a plant must be participating for 50% of the sampling year.

For the 1999 / 2000 sampling year this represented 13 periods.

There were 59 plants eligible for the certificates in 1999 / 2000. The Altona plant is not eligible for the certificate program because it is a sampling location only.

1) CERTIFICATE OF EXCELLENCE

The selection criteria are:

A) 100% of bi-weekly samples must be submitted for the sampling year

and

B) 100% of submitted samples must be within the recommended operating range for fluoride concentration

In 1999 / 2000 certificates were presented to 24 water plant supervisors/operators. This represents 41% of the total number of eligible community fluoridation systems.

2) CERTIFICATE OF COMMENDATION

The selection criteria are:

A) 85% or 22 out of 26 bi-weekly samples must be submitted for the sampling year,

and

B) 90% of submitted samples must be within there commended operating range for fluoride concentration.

In 1999 / 2000 certificates were presented to 16 water plant supervisors. This represents 27% of the total number of eligible community fluoridation systems.

CERTIFICATES
1999 / 2000 RECIPIENTS

1) Certificate of Excellence

Recipient	Plant Location	Operating Authority
Mr. Rick Kinaschuk & Staff	Benito	Infrastructure Service
Mr. George Jago & Staff	Brandon	City of Brandon
Mr. Eric Blacksmith & Staff	Cross Lake Reserve	CL Water Authority
Mr. Ken Podruski & Staff	Erickson	Infrastructure Service
Mr. Kevin Komarnicki & Staff	Flin Flon	City of Flin Flon
Mr. Richard Bezdietny & Staff	Gimli Industrial Park	Gimli Industrial Park
Mr. Greg Morrison & Staff	Hartney	Town of Hartney
Mr. Jack Cronk & Staff	Letellier	Infrastructure Service
Mr. Bob Barrett & Staff	Manitou	Infrastructure Service
Mr. Bob Reddaway & Staff	Melita	Town of Melita
Mr. Larry Benoit & Staff	Morden	Town of Morden
Mr. Ron McDowall & Staff	Pinawa	L.G.D. of Pinawa
Mr. Doug Campbell & Staff	Portage la Prairie	City of Portage la Prairie
Mr. Ken Moore & Staff	Reston	Infrastructure Service
Mr. Glen Reierson & Staff	Roblin	Town of Roblin
Mr. Gerald Best & Staff	Russell	Infrastructure Service
Mr. Henry Tremorin Sr. & Staff	St. Claude	Village of St. Claude
Mr. Claude Collette & Staff	Sanford	R.M. of MacDonald
Mr. Ernie Sorgenson & Staff	Snow Lake	Town of Snow Lake
Mr. Don Doyle & Staff	Steinbach	Town of Steinbach
Mr. Garry Kennedy & Staff	Swan River	Town of Swan River
Mr. Ronald Stewart & Staff	The Pas	Town of The Pas
Mr. Ken Lawrence & Staff	Treherne	Village of Treherne
Mr. Arnold Permut & Staff	Winnipeg	City of Winnipeg

2) Certificate of Commendation

Recipient	Plant Location	Operating Authority
Mr. Don Hotel & Staff	Austin	R.M. of Austin
Mr. Barry Chinner & Staff	Boissevain	Town of Boissevain
Mr. Dixie Nagy & Staff	Cranberry Portage	Infrastructure Service
Mr. Jack Blacksmith & Staff	Cross Lake Saggitawak	CL Saggitawak
Mr. Eugene Mayuk & Staff	Dauphin	Town of Dauphin
Mr. Wayne Sheridan & Staff	Gladstone	Town of Gladstone
Mr. Brian Park & Staff	Hamiota	Infrastructure Service
Mr. John McLean & Staff	McCreary	Infrastructure Service
Mr. Richard Dupuis & Staff	Morris	Town of Morris
Mr. Steve Mowatt & Staff	Norway House Comm Council	Town of Norway House
Mr. Gary Odlum & Staff	Pilot Mound	Infrastructure Service
Mr. Randy King & Staff	Rivers	Town of Rivers
Mr. Nick Antonow & Staff	Rossburn	Infrastructure Service
Mr. Bill Zander & Staff	Souris	Town of Souris
Mr. Norm Baxter & Staff	Virden	Town of Virden
Mr. John Schmidt & Staff	Winkler	Town of Winkler

V. INFRASTRUCTURE SERVICES
(Formerly Manitoba Water Services Board)

Infrastructure Services owns and operates a number of treatment facilities across Manitoba and provides water to communities.

In communities currently fluoridating the Infrastructure Services works cooperatively with Manitoba Health to ensure that the requirements of the fluoridation monitoring system are met.

In communities wishing to fluoridate the Infrastructure Services works in conjunction with Manitoba Health to assess the water treatment facility design the fluoridation system and coordinate installation and start-up.

Infrastructure Services plant operators are trained by Manitoba Health staff in proper testing operating and maintenance procedures for their specific fluoridation systems.

VI. SUPPORT SERVICES

Manitoba Health wishes to acknowledge the support received from various groups and government departments which provided assistance with the performance of the Community Water Fluoridation Program:

i. Mayors, Community Councils, Waterworks Chairpersons, Band Councils, and especially water treatment plant operators and supervisors in all locations with community water fluoridation systems in operation.

ii. Infrastructure Services for the cooperative efforts made to ensure Manitoba Health standards were observed in all fluoridating locations.

iii. The EnviroTest Laboratories for the provision of fluoride level analyses, the distribution of reagents, sample bottles and fluoride results to participating communities, the preparation of this report and other administrative services.

iv. Manitoba Conservation for the provision of inspection and surveillance services in water plants, as well as consultation services.

v. Medical Services Branch, Health Canada for the promotion of fluoridation on Manitoba First Nation communities.

vi. Equipment manufacturers and suppliers for assistance with system design, especially Prairie Chem Inc. for promotion services and consultation assistance.

vii. Cochrane Engineering, design consultants, for consulting services.

All of the above individuals and agencies have been instrumental in the provision of this important preventive dental health measure to the citizens of Manitoba.

FOR FURTHER INFORMATION REGARDING MANITOBA'S COMMUNITY WATER FLUORIDATION PROGRAM PLEASE CONTACT:

Dr. Bernadette Des Marais
Manitoba Health
Public Health Branch
Room 4068
300 Carlton Street
Winnipeg MB R3B 3M9

Telephone: (204) 788-6729
Fax: (204) 948-2040
Email: bdesmarais@health.gov.mb.ca

VII
FLUORIDE
CONTROL
DATA
1999 / 2000

MANITOBA HEALTH FLUORIDE MONITORING PROGRAM TABLE III

FLUORIDE CONTROL DATA - 1999/2000 - SUMMARY

THE FIGURES IN THIS TABLE REFLECT THE RESULTS OF THE TESTING OF BI-WEEKLY COMPOSITE SAMPLES FOR FLUORIDE CONCENTRATION IN PARTS PER MILLION

PERIOD:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26
ALTONA	1.10	1.20	1.00	1.00	1.00	-	-	1.10	1.00	0.90	1.00	1.00	1.10	1.00	1.00	1.00	1.10	1.00	1.10	1.00	1.00	1.10	-	1.20	1.20	1.20
AUSTIN	1.20	0.80	1.30	1.20	1.00	1.30	1.00	1.20	0.80	0.90	1.10	2.00	1.10	1.20	1.10	1.00	1.00	0.80	0.80	0.80	0.90	1.00	1.00	0.80	1.00	1.00
BALDUR	1.00	1.00	1.00	0.80	1.00	0.90	1.00	1.00	0.90	0.90	0.80	0.60	0.70	0.80	0.80	0.70	0.80	0.70	0.60	0.70	0.80	0.70	0.80	0.90	0.80	0.90
BENITO	1.00	1.20	1.00	0.80	1.00	1.00	1.00	1.10	1.00	1.00	1.10	1.10	1.00	1.00	1.10	0.90	1.00	1.00	1.20	1.00	1.10	1.00	1.10	1.00	1.10	1.00
BINSCARTH	0.80	0.80	0.80	0.80	0.80	0.90	0.80	0.90	0.90	0.80	0.90	0.90	0.80	0.80	0.70	0.60	0.50	0.70	0.70	0.70	0.80	0.80	0.80	0.80	0.60	0.60
BIRTLE	1.20	1.40	1.30	1.00	1.20	1.20	1.30	1.20	1.10	1.30	1.30	1.30	1.30	1.50	1.20	1.00	0.90	0.90	0.50	0.90	1.00	0.80	0.90	0.70	0.70	1.00
BOISSEVAIN	0.90	0.80	0.60	0.70	0.80	0.80	1.00	0.80	0.80	0.80	0.90	0.80	0.90	1.00	1.00	0.90	1.00	1.00	1.00	0.90	1.10	0.90	1.00	1.00	1.00	1.00
BRANDON	-	1.00	0.90	0.70	0.80	0.90	0.90	1.00	0.90	0.90	0.90	0.80	0.80	0.90	1.00	1.00	1.10	1.10	1.10	1.00	1.10	1.10	1.00	1.00	1.10	1.00
CARMAN	1.20	1.00	1.00	1.00	1.00	1.00	1.10	1.00	1.40	1.00	0.60	0.70	0.80	0.80	0.60	0.60	0.60	0.60	0.60	0.60	0.80	0.80	0.70	0.80	0.90	0.70
CFB SHILO	0.80	1.10	1.00	0.80	1.00	1.00	0.70	0.70	0.90	0.10	0.80	0.60	0.50	1.10	0.90	0.80	1.00	1.00	1.00	0.90	1.00	0.90	0.90	0.90	0.90	0.70
CHURCHILL	0.80	1.20	0.80	1.10	1.10	0.80	1.00	0.50	0.80	0.50	0.50	0.40	0.60	0.70	0.80	0.60	1.00	0.60	0.70	0.90	0.80	0.80	0.70	0.80	0.60	0.90
CRANBERRY PORTAGE	0.80	3.30	3.60	0.50	1.00	1.20	1.10	1.20	1.20	1.10	1.10	1.10	1.30	1.20	1.20	1.10	1.20	1.20	1.10	1.00	1.00	1.10	1.00	1.00	0.90	1.00
CROSS LAKE (COMM)	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
CROSS LAKE (RES)	1.10	1.10	1.10	1.00	1.00	1.00	1.00	0.90	1.00	0.90	1.10	0.80	1.00	1.10	1.00	1.00	1.10	1.20	1.00	1.10	1.00	1.20	1.00	1.10	1.10	1.00
CROSS LAKE (SAGG)	0.70	1.00	0.80	1.00	1.00	0.70	1.00	0.90	0.60	0.90	1.00	0.50	0.90	1.10	1.00	1.00	1.00	1.10	1.00	1.00	1.00	0.90	0.80	1.00	0.80	0.80
DAUPHIN	1.20	1.10	1.10	1.10	1.10	1.10	1.10	1.00	0.80	0.90	0.80	0.70	0.70	0.60	0.80	1.00	0.90	1.00	1.00	0.80	0.80	0.80	0.80	0.80	0.90	0.80
DELORAINE	0.90	0.70	0.80	0.90	0.80	0.70	0.50	0.80	0.80	0.50	0.70	0.90	0.90	0.90	0.70	0.50	1.00	1.10	0.80	0.30	0.60	0.40	0.90	0.90	1.00	1.00
ERICKSON	0.90	1.00	0.90	0.90	1.10	0.80	0.90	0.80	1.00	1.40	1.00	1.00	1.00	0.80	0.90	0.90	1.00	1.10	0.90	1.00	1.00	1.20	0.90	0.90	0.90	0.90
FLIN FLON	1.00	1.00	1.00	0.90	1.00	1.00	1.00	1.10	0.90	1.00	0.90	1.00	1.00	1.00	1.00	0.80	1.00	1.00	1.10	1.00	1.00	0.90	0.80	1.00	1.00	0.90
GILBERT PLAINS	1.30	1.40	1.00	0.70	0.60	0.30	0.30	0.20	0.20	0.30	1.10	1.20	1.10	0.80	0.60	0.50	1.20	1.40	-	1.00	0.70	0.60	0.40	0.70	1.20	1.40
GILLAM	0.80	1.20	1.10	1.10	1.20	1.20	1.40	1.50	0.90	0.70	0.60	0.80	1.00	1.00	1.20	1.20	1.20	1.40	1.20	1.10	1.00	1.00	1.00	1.10	1.10	1.00
GIMLI IND. PARK	1.00	1.00	0.90	0.70	1.00	1.00	1.00	1.00	0.90	1.00	1.00	0.80	1.00	1.00	1.00	0.90	1.00	1.00	0.90	0.90	1.10	1.00	1.00	1.10	0.90	0.80
GIMLI (TOWN)	1.10	0.90	1.10	1.00	1.10	1.10	1.00	0.90	0.90	1.00	1.10	0.90	1.00	1.00	1.10	0.70	-	-	-	-	-	-	-	1.00	1.00	1.10
GLADSTONE	1.30	1.10	1.20	1.00	1.00	1.10	1.10	1.00	0.80	0.90	0.90	1.00	0.80	0.90	1.10	1.00	1.00	1.00	1.00	1.00	1.00	1.00	0.90	1.40	1.00	1.00
GRISWOLD SIOUX VALLEY	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	1.20	1.10	15.10	0.80	1.20	5.60	12.60	0.60	-
HAMIOTA	1.10	1.30	1.20	1.10	0.90	1.00	1.10	0.70	0.90	1.00	1.00	0.90	1.00	1.00	1.00	0.80	0.90	1.10	1.00	0.90	1.00	1.00	0.90	0.60	-	1.00
HARTNEY	1.20	1.20	1.00	0.70	0.80	0.80	0.90	1.00	0.80	1.20	1.20	1.10	0.80	1.00	1.10	0.90	0.80	0.80	0.90	0.80	0.90	1.20	1.10	1.10	1.00	0.90
KILLARNEY	1.60	1.30	1.40	1.20	1.10	1.70	1.40	1.80	1.30	2.30	1.80	2.00	3.60	3.00	2.10	2.10	2.30	2.20	1.60	1.40	2.70	1.70	1.60	1.50	2.20	2.10
LAC DU BONNET	0.80	1.10	1.10	1.10	1.20	1.20	-	0.80	1.10	1.80	1.10	0.90	0.40	1.00	0.80	0.80	0.60	1.10	0.90	1.00	1.00	0.90	0.70	1.00	1.10	1.00
LETELLIER	1.10	1.20	1.10	1.00	1.00	1.00	1.00	1.10	1.00	0.90	1.00	1.00	1.00	1.10	1.00	1.00	0.90	1.00	1.00	1.00	1.10	1.10	1.20	1.20	1.20	1.20
LONG PLAIN	1.10	1.20	1.40	0.80	1.20	1.30	1.10	1.20	1.20	1.10	1.20	1.00	1.30	1.10	1.30	1.10	1.10	1.30	1.20	1.00	1.00	1.10	-	0.90	1.10	1.00
MANITOU	1.00	1.00	1.00	0.90	1.00	1.00	1.00	1.10	1.00	0.80	1.20	1.00	1.10	1.00	0.90	1.20	1.20	1.10	1.10	1.00	1.10	1.00	1.00	1.00	1.00	1.00
MCCREARY	1.00	1.00	0.40	0.30	1.00	0.90	0.80	0.80	0.80	0.90	1.00	0.90	0.80	0.80	0.80	1.10	0.80	0.90	0.90	-	0.80	1.00	0.90	0.80	1.00	0.90
MELITA	0.90	0.90	0.80	0.70	0.80	1.20	0.90	0.90	0.90	0.80	0.90	0.80	0.80	0.80	1.20	1.00	0.90	1.00	1.00	1.00	1.50	1.00	1.00	1.00	1.00	0.90
MINNEDOSA	0.70	1.40	1.10	1.10	-	1.10	1.00	-	-	1.00	1.00	-	1.00	0.90	1.30	1.30	1.30	1.10	1.00	1.00	1.00	1.00	1.10	1.00	1.10	1.00
MORDEN	1.00	1.10	1.00	0.90	1.00	1.00	0.90	0.90	0.90	0.90	1.10	0.90	0.90	0.90	0.80	0.90	0.70	1.00	0.80	0.90	0.90	0.90	0.90	0.90	1.10	1.00
MORRIS	1.10	1.30	1.40	1.20	1.00	0.90	1.00	1.00	1.00	1.00	1.00	1.00	0.80	1.10	1.10	1.10	0.90	0.90	0.80	0.80	0.90	0.90	0.80	0.90	0.80	0.80
NEEPAWA	0.80	1.00	0.80	0.70	0.90	1.00	0.90	1.00	0.80	1.00	0.80	0.90	0.80	0.90	0.80	0.90	0.70	0.80	0.50	0.60	0.70	0.80	-	1.00	1.10	1.00
NORWAY HOUSE COMM	1.00	1.00	1.00	0.90	1.20	1.50	1.20	1.10	1.00	1.00	1.10	1.40	1.20	1.20	1.00	0.80	1.00	1.00	0.80	0.80	0.80	0.80	0.80	0.90	0.70	0.60
NORWAY HOUSE CREE	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
PILOT MOUND	0.90	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	0.90	1.00	1.00	0.90	1.00	0.90	0.90	0.90	0.80	0.80	0.70	-	0.70	0.60	1.20	1.40	0.80
PINAWA	1.00	1.00	1.00	1.00	1.00	0.90	0.90	1.00	1.00	1.00	1.00	0.90	0.90	0.90	0.90	1.00	1.00	1.00	0.80	0.90	0.90	0.90	0.80	0.90	1.00	0.90
PORTAGE	1.10	1.10	1.10	1.00	1.00	1.10	1.00	1.00	1.00	1.00	1.00	0.90	0.80	0.90	0.80	0.60	1.00	1.00	0.80	0.80	0.90	1.00	1.10	1.00	1.10	1.10
RESTON	1.20	1.10	0.80	0.80	1.00	0.80	1.10	0.90	0.80	1.10	1.00	1.00	1.10	1.00	0.80	0.80	1.00	1.20	0.90	1.00	1.10	1.00	1.00	0.80	0.90	0.80
RIVERS	1.00	1.10	0.90	0.90	1.00	1.10	1.10	1.10	1.20	0.90	1.10	1.00	1.70	1.30	1.00	1.10	1.00	1.20	1.20	1.10	1.10	1.00	1.00	1.10	1.00	1.00
ROBLIN	0.90	1.00	1.00	1.00	0.80	1.10	1.10	1.10	1.10	1.10	1.10	1.00	1.10	1.00	1.10	1.00	0.80	1.00	1.00	0.90	0.90	0.90	0.90	0.90	0.90	1.00
ROSSBURN	1.10	1.20	1.00	0.80	0.80	0.80	1.20	1.30	1.50	1.30	0.80	0.70	0.80	1.10	1.10	1.00	0.90	1.00	0.90	-	0.90	1.00	1.00	0.90	0.90	0.90
RUSSELL	-	0.90	1.00	0.80	0.90	1.00	0.90	1.00	0.90	1.00	1.00	1.00	1.10	1.30	1.00	0.90	1.00	1.00	0.90	0.90	0.90	0.80	0.80	0.80	0.90	0.80
ST. CLAUDE	0.90	0.90	1.00	0.80	1.00	1.00	1.00	0.90	1.10	-	1.00	0.90	1.00	1.00	1.00	0.90	1.00	1.00	0.80	0.80	0.90	0.90	0.80	1.00	1.00	0.90
STE. ROSE DU LAC	1.00	0.80	0.80	0.70	0.60	0.80	1.00	1.00	0.80	0.50	1.00	0.70	0.70	0.80	0.30	0.70	0.70	0.80	-	-	-	0.20	0.40	0.50	0.40	0.30
SANDY BAY	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
SANFORD	1.20	1.10	1.10	1.00	1.10	1.10	1.10	1.20	1.10	1.00	1.10	0.90	1.00	1.00	1.10	1.20	1.20	1.10	1.10	1.10	1.10	1.00	1.00	1.00	1.10	1.00
SHOAL LAKE	2.60	0.50	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
SNOW LAKE	1.00	0.90	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	0.90	0.80	0.90	0.80	0.80	1.00	1.00	1.00	1.10	0.80	0.70	0.80	0.80	1.00	0.90	0.90
SOURIS	0.80	1.10	0.90	0.80	0.90	0.80	0.90	0.90	0.80	0.80	0.50	0.80	0.80	0.80	0.90	0.80	0.90	0.90	1.00	0.80	1.00	1.00	0.80	0.90	0.70	1.10
STEINBACH	1.10	1.10	1.00	1.00	1.00	1.00	1.00	1.00	1.00	0.90	1.10	1.20	1.20	1.10	1.10	0.80	1.00	1.10	1.10	1.10	1.00	1.10	1.00	1.10	1.10	1.00
STEPHENFIELD	-	0.60	0.50	0.50	0.60	0.40	0.90	1.00	1.00	1.00	1.10	1.10	1.20	1.20	1.00	0.80	0.70	0.90	0.80	0.90	0.90	0.90	0.80	1.00	1.00	0.90
SWAN RIVER	1.10	1.10	1.00	0.80	1.10	0.80	0.90	1.30	1.00	1.00	1.00	1.00	0.80	0.90	0.80	1.00	0.80	1.00	0.90	0.80	1.20	1.00	1.10	1.00	1.00	1.10
THE PAS	1.10	1.10	1.00	1.00	0.90	1.00	0.90	1.00	0.90	0.90	1.00	0.80	0.90	1.00	1.00	0.90	1.00	1.00	1.00	1.00	1.00	0.90	1.00	0.90	1.00	0.90
TREHERNE	1.00	1.00	1.00	1.00	1.00	1.10	0.90	1.00	1.00	0.90	1.20	0.80	1.00	0.90	1.00	1.00	1.10	1.00	1.20	1.00	1.10	1.00	0.90	1.10	1.30	0.90
VIRDEN	1.10	1.20	1.30	1.30	0.90	1.00	1.10	0.90	1.00	1.10	1.00	0.90	0.70	1.20	1.00	1.00	1.00	1.00	1.00	1.00	1.10	1.00	1.00	1.10	0.90	0.90
WABOWDEN	0.40	1.10	1.20	1.10	0.70	1.00	0.90	1.00	1.10	0.80	0.80	0.80	0.90	0.90	1.10	1.00	0.80	1.00	0.60	0.60	0.70	0.80	0.80	0.70	0.80	0.90
WINKLER	0.90	0.90	0.90	0.80	1.00	1.00	1.00	1.10	1.00	1.10	1.20	1.00	1.00	1.00	1.00	1.40	1.20	1.10	0.90	0.90	1.10	1.00	1.00	1.00	1.10	0.80
WINNIPEG	0.90	0.90	0.90	0.90	0.90	1.00	0.90	1.00	0.90	0.80	0.80	0.90	0.90	0.90	1.00	1.00	0.90	1.00	0.90	0.90	1.00	1.00	1.00	1.00	1.10	0.90
WINNIPEGOSIS	1.20	1.40	1.10	1.20	1.10	1.10	1.10	1.60	2.50	-	-	-	-	1.00	1.10	1.10	1.00	-	-	-	-	-	-	-	-	-

FLUORIDATION CONTROL DATA - KEY

All figures reported are recorded in parts per million (p.p.m.) or milligrams per litre (mg/l).

COMPOSITE (LAB)
Fluoride level analysis conducted by the EnviroTest Laboratories on the bi-weekly composite sample submitted by the water plant operator.

COMPOSITE (OPERATOR)
Fluoride level analysis conducted and reported by the water treatment plant operator on the bi-weekly sample before it is submitted to the EnviroTest Laboratories.

NOTE: If "NOT AVAIL" appears in any column, it indicates that data is not available due to one of the following reasons:

- sample not submitted
- sample broken in transit
- information not provided
- sample was contaminated

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	ALTONA	**FLUORIDATOR:**	NIL
CHEMICAL:	H_2SiF_6 25%	**OPERATOR:**	Wayne Dueck
NATURAL FLUORIDE:	0.29	**TELEPHONE:**	324-6439

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.10	NOT AVAIL
2. APR 10 - APR 23	1.20	NOT AVAIL
3. APR 24 - MAY 7	1.00	NOT AVAIL
4. MAY 8 - MAY 21	1.00	NOT AVAIL
5. MAY 22 - JUNE 4	1.00	NOT AVAIL
6. JUNE 5 - JUNE 18	NOT AVAIL	NOT AVAIL
7. JUNE 19 - JULY 2	NOT AVAIL	NOT AVAIL
8. JULY 3 - JULY 16	1.10	NOT AVAIL
9. JULY 17 - JULY 30	1.00	NOT AVAIL
10. JUL 31 - AUG 13	0.90	NOT AVAIL
11. AUG 14 - AUG 27	1.00	NOT AVAIL
12. AUG 28 - SEPT 10	1.00	NOT AVAIL
13. SEPT 11 - SEPT 24	1.10	NOT AVAIL
14. SEPT 26 - OCT 8	1.00	NOT AVAIL
15. OCT 9 - OCT 22	1.00	NOT AVAIL
16. OCT 23 - NOV 5	1.00	NOT AVAIL
17. NOV 6 - NOV 19	1.10	NOT AVAIL
18. NOV 20 - DEC 3	1.00	NOT AVAIL
19. DEC 4 - DEC 17	1.10	NOT AVAIL
20. DEC 18 - DEC 31	1.00	NOT AVAIL
21. JAN 1 - JAN 14	1.00	NOT AVAIL
22. JAN 15 - JAN 28	1.10	NOT AVAIL
23. JAN 29 - FEB 11	NOT AVAIL	NOT AVAIL
24. FEB 12 - FEB 25	1.20	NOT AVAIL
25. FEB 26 - MAR 10	1.20	NOT AVAIL
26. MAR 11 - MAR 24	1.20	NOT AVAIL
AVERAGE TO DATE	1.06	0.00
RANGE - LOW	0.90	0.00
TO DATE - HIGH	1.20	0.00
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	0	
% OUTSIDE LIMITS TO DATE	0.00%	
NUMBER OF SAMPLES TO DATE	23	

Note: Altona is a sampling location only.

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	AUSTIN	**FLUORIDATOR:**	LMI A151
CHEMICAL:	NaF 4%	**OPERATOR:**	Don Hotel
NATURAL FLUORIDE:	0.19	**TELEPHONE:**	637-2101

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.20	1.16
2. APR 10 - APR 23	0.80	0.87
3. APR 24 - MAY 7	1.30	1.18
4. MAY 8 - MAY 21	1.20	1.10
5. MAY 22 - JUNE 4	1.00	1.02
6. JUNE 5 - JUNE 18	1.30	1.09
7. JUNE 19 - JULY 2	1.00	1.04
8. JULY 3 - JULY 16	1.20	1.12
9. JULY 17 - JULY 30	0.80	0.92
10. JUL 31 - AUG 13	0.90	1.00
11. AUG 14 - AUG 27	1.10	1.07
12. AUG 28 - SEPT 10	2.00	1.20
13. SEPT 11 - SEPT 24	1.10	1.04
14. SEPT 26 - OCT 8	1.20	0.95
15. OCT 9 - OCT 22	1.10	0.90
16. OCT 23 - NOV 5	1.00	1.02
17. NOV 6 - NOV 19	1.00	1.17
18. NOV 20 - DEC 3	0.80	0.97
19. DEC 4 - DEC 17	0.80	0.86
20. DEC 18 - DEC 31	0.80	NOT AVAIL
21. JAN 1 - JAN 14	0.90	0.97
22. JAN 15 - JAN 28	1.00	1.13
23. JAN 29 - FEB 11	1.00	0.85
24. FEB 12 - FEB 25	0.80	1.01
25. FEB 26 - MAR 10	1.00	1.07
26. MAR 11 - MAR 24	1.00	1.00
AVERAGE TO DATE	1.05	1.03
RANGE - LOW	0.80	0.85
TO DATE - HIGH	2.00	1.20
SAMPLES ABOVE LIMITS	3	
SAMPLES BELOW LIMITS	0	
% OUTSIDE LIMITS TO DATE	11.54%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	BALDUR	**FLUORIDATOR:**	LMI A151
CHEMICAL:	NaF 4%	**OPERATOR:**	Darcy Dearsley
NATURAL FLUORIDE:	0.22	**TELEPHONE:**	535-2047

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.00	0.91
2. APR 10 - APR 23	1.00	0.95
3. APR 24 - MAY 7	1.00	0.99
4. MAY 8 - MAY 21	0.80	0.99
5. MAY 22 - JUNE 4	1.00	0.94
6. JUNE 5 - JUNE 18	0.90	0.96
7. JUNE 19 - JULY 2	1.00	0.99
8. JULY 3 - JULY 16	1.00	0.94
9. JULY 17 - JULY 30	0.90	0.96
10. JUL 31 - AUG 13	0.90	1.00
11. AUG 14 - AUG 27	0.80	0.99
12. AUG 28 - SEPT 10	0.60	0.89
13. SEPT 11 - SEPT 24	0.70	0.92
14. SEPT 26 - OCT 8	0.80	0.95
15. OCT 9 - OCT 22	0.80	0.91
16. OCT 23 - NOV 5	0.70	0.25
17. NOV 6 - NOV 19	0.80	0.95
18. NOV 20 - DEC 3	0.70	0.85
19. DEC 4 - DEC 17	0.60	0.83
20. DEC 18 - DEC 31	0.70	0.94
21. JAN 1 - JAN 14	0.80	0.97
22. JAN 15 - JAN 28	0.70	0.87
23. JAN 29 - FEB 11	0.80	0.91
24. FEB 12 - FEB 25	0.90	1.03
25. FEB 26 - MAR 10	0.80	0.97
26. MAR 11 - MAR 24	0.90	0.96
AVERAGE TO DATE	0.83	0.92
RANGE - LOW TO DATE - HIGH	0.60 1.00	0.25 1.03
SAMPLES ABOVE LIMITS SAMPLES BELOW LIMITS	0 7	
% OUTSIDE LIMITS TO DATE	26.92%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	BENITO	**FLUORIDATOR:**	LMI A151
CHEMICAL:	NaF 4%	**OPERATOR:**	Rick Kinaschuk
NATURAL FLUORIDE:	0.3	**TELEPHONE:**	539-2229

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.00	1.10
2. APR 10 - APR 23	1.20	1.10
3. APR 24 - MAY 7	1.00	1.10
4. MAY 8 - MAY 21	0.80	1.00
5. MAY 22 - JUNE 4	1.00	1.00
6. JUNE 5 - JUNE 18	1.00	1.00
7. JUNE 19 - JULY 2	1.00	1.00
8. JULY 3 - JULY 16	1.10	1.00
9. JULY 17 - JULY 30	1.00	1.10
10. JUL 31 - AUG 13	1.00	1.00
11. AUG 14 - AUG 27	1.10	1.10
12. AUG 28 - SEPT 10	1.10	1.10
13. SEPT 11 - SEPT 24	1.00	1.10
14. SEPT 26 - OCT 8	1.00	1.00
15. OCT 9 - OCT 22	1.10	1.00
16. OCT 23 - NOV 5	0.90	1.00
17. NOV 6 - NOV 19	1.00	1.00
18. NOV 20 - DEC 3	1.00	1.00
19. DEC 4 - DEC 17	1.20	1.10
20. DEC 18 - DEC 31	1.00	1.00
21. JAN 1 - JAN 14	1.10	1.10
22. JAN 15 - JAN 28	1.00	1.10
23. JAN 29 - FEB 11	1.10	1.10
24. FEB 12 - FEB 25	1.00	1.10
25. FEB 26 - MAR 10	1.10	1.00
26. MAR 11 - MAR 24	1.00	1.00
AVERAGE TO DATE	1.03	1.05
RANGE - LOW	0.80	1.00
TO DATE - HIGH	1.20	1.10
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	0	
% OUTSIDE LIMITS TO DATE	0.00%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	BINSCARTH	**FLUORIDATOR:**	Prom Gamma IV
CHEMICAL:	H_2SiF_6 25%	**OPERATOR:**	Steve Stewart
NATURAL FLUORIDE:	0.24	**TELEPHONE:**	532-2165

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	0.80	0.96
2. APR 10 - APR 23	0.80	0.89
3. APR 24 - MAY 7	0.80	0.93
4. MAY 8 - MAY 21	0.80	1.01
5. MAY 22 - JUNE 4	0.80	0.96
6. JUNE 5 - JUNE 18	0.90	0.88
7. JUNE 19 - JULY 2	0.80	0.96
8. JULY 3 - JULY 16	0.90	0.84
9. JULY 17 - JULY 30	0.90	0.94
10. JUL 31 - AUG 13	0.80	0.88
11. AUG 14 - AUG 27	0.90	0.82
12. AUG 28 - SEPT 10	0.90	0.93
13. SEPT 11 - SEPT 24	0.80	0.94
14. SEPT 26 - OCT 8	0.80	1.13
15. OCT 9 - OCT 22	0.70	1.00
16. OCT 23 - NOV 5	0.60	1.00
17. NOV 6 - NOV 19	0.50	0.79
18. NOV 20 - DEC 3	0.70	0.81
19. DEC 4 - DEC 17	0.70	1.14
20. DEC 18 - DEC 31	0.70	1.01
21. JAN 1 - JAN 14	0.80	1.13
22. JAN 15 - JAN 28	0.80	1.08
23. JAN 29 - FEB 11	0.80	0.98
24. FEB 12 - FEB 25	0.80	0.98
25. FEB 26 - MAR 10	0.60	0.99
26. MAR 11 - MAR 24	0.60	1.15
AVERAGE TO DATE	0.77	0.97
RANGE - LOW	0.50	0.79
TO DATE - HIGH	0.90	1.15
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	8	
% OUTSIDE LIMITS TO DATE	30.77%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	BIRTLE	**FLUORIDATOR:**	LMI A741
CHEMICAL:	NaF 4%	**OPERATOR:**	Darwin Fluery
NATURAL FLUORIDE:	0.26	**TELEPHONE:**	842-5311

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.20	1.61
2. APR 10 - APR 23	1.40	1.65
3. APR 24 - MAY 7	1.30	1.57
4. MAY 8 - MAY 21	1.00	1.49
5. MAY 22 - JUNE 4	1.20	1.57
6. JUNE 5 - JUNE 18	1.20	1.66
7. JUNE 19 - JULY 2	1.30	1.55
8. JULY 3 - JULY 16	1.20	1.47
9. JULY 17 - JULY 30	1.10	1.38
10. JUL 31 - AUG 13	1.30	1.36
11. AUG 14 - AUG 27	1.30	1.56
12. AUG 28 - SEPT 10	1.30	1.48
13. SEPT 11 - SEPT 24	1.30	1.53
14. SEPT 26 - OCT 8	1.50	1.91
15. OCT 9 - OCT 22	1.20	1.92
16. OCT 23 - NOV 5	1.00	1.36
17. NOV 6 - NOV 19	0.90	1.39
18. NOV 20 - DEC 3	0.90	1.47
19. DEC 4 - DEC 17	0.50	1.48
20. DEC 18 - DEC 31	0.90	1.61
21. JAN 1 - JAN 14	1.00	1.64
22. JAN 15 - JAN 28	0.80	1.44
23. JAN 29 - FEB 11	0.90	1.36
24. FEB 12 - FEB 25	0.70	1.53
25. FEB 26 - MAR 10	0.70	1.45
26. MAR 11 - MAR 24	1.00	1.60
AVERAGE TO DATE	1.08	1.54
RANGE - LOW	0.50	1.36
TO DATE - HIGH	1.50	1.92
SAMPLES ABOVE LIMITS	8	
SAMPLES BELOW LIMITS	3	
% OUTSIDE LIMITS TO DATE	42.31%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	BOISSEVAIN	**FLUORIDATOR:**	Precision
CHEMICAL:	NaF 4%	**OPERATOR:**	Barry Chinner
NATURAL FLUORIDE:	0.2	**TELEPHONE:**	534-6762

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	0.90	0.85
2. APR 10 - APR 23	0.80	0.90
3. APR 24 - MAY 7	0.60	0.80
4. MAY 8 - MAY 21	0.70	0.90
5. MAY 22 - JUNE 4	0.80	1.00
6. JUNE 5 - JUNE 18	0.80	0.90
7. JUNE 19 - JULY 2	1.00	0.95
8. JULY 3 - JULY 16	0.80	0.80
9. JULY 17 - JULY 30	0.80	1.00
10. JUL 31 - AUG 13	0.80	0.95
11. AUG 14 - AUG 27	0.90	0.95
12. AUG 28 - SEPT 10	0.80	0.95
13. SEPT 11 - SEPT 24	0.90	0.95
14. SEPT 26 - OCT 8	1.00	1.00
15. OCT 9 - OCT 22	1.00	1.00
16. OCT 23 - NOV 5	0.90	1.00
17. NOV 6 - NOV 19	1.00	1.00
18. NOV 20 - DEC 3	1.00	0.90
19. DEC 4 - DEC 17	1.00	0.90
20. DEC 18 - DEC 31	0.90	0.90
21. JAN 1 - JAN 14	1.10	1.00
22. JAN 15 - JAN 28	0.90	0.90
23. JAN 29 - FEB 11	1.00	0.95
24. FEB 12 - FEB 25	1.00	0.95
25. FEB 26 - MAR 10	1.00	0.95
26. MAR 11 - MAR 24	1.00	0.95
AVERAGE TO DATE	0.90	0.93
RANGE - LOW	0.60	0.80
TO DATE - HIGH	1.10	1.00
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	2	
% OUTSIDE LIMITS TO DATE	7.69%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	BRANDON	**FLUORIDATOR:**	W&T A690
CHEMICAL:	Na_2SiF_6 (Dry)	**OPERATOR:**	George Jago
NATURAL FLUORIDE:	0.2	**TELEPHONE:**	729-2274

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	NOT AVAIL	NOT AVAIL
2. APR 10 - APR 23	1.00	1.10
3. APR 24 - MAY 7	0.90	1.00
4. MAY 8 - MAY 21	0.70	1.01
5. MAY 22 - JUNE 4	0.80	0.99
6. JUNE 5 - JUNE 18	0.90	1.18
7. JUNE 19 - JULY 2	0.90	1.02
8. JULY 3 - JULY 16	1.00	1.02
9. JULY 17 - JULY 30	0.90	1.03
10. JUL 31 - AUG 13	0.90	1.01
11. AUG 14 - AUG 27	0.90	1.04
12. AUG 28 - SEPT 10	0.80	0.93
13. SEPT 11 - SEPT 24	0.80	1.04
14. SEPT 26 - OCT 8	0.90	0.95
15. OCT 9 - OCT 22	1.00	1.21
16. OCT 23 - NOV 5	1.00	1.21
17. NOV 6 - NOV 19	1.10	1.00
18. NOV 20 - DEC 3	1.10	1.16
19. DEC 4 - DEC 17	1.10	1.10
20. DEC 18 - DEC 31	1.00	0.82
21. JAN 1 - JAN 14	1.10	1.03
22. JAN 15 - JAN 28	1.10	1.11
23. JAN 29 - FEB 11	1.00	1.13
24. FEB 12 - FEB 25	1.00	1.11
25. FEB 26 - MAR 10	1.10	1.15
26. MAR 11 - MAR 24	1.00	1.10
AVERAGE TO DATE	0.96	1.06
RANGE - LOW TO DATE - HIGH	0.70 1.10	0.82 1.21
SAMPLES ABOVE LIMITS SAMPLES BELOW LIMITS	0 1	
% OUTSIDE LIMITS TO DATE	4.00%	
NUMBER OF SAMPLES TO DATE	25	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	C.F.B. SHILO	**FLUORIDATOR:**	LMI Saturator
CHEMICAL:	NaF 4%	**OPERATOR:**	Bill Burke
NATURAL FLUORIDE:	0.05	**TELEPHONE:**	765-4723

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	0.80	0.93
2. APR 10 - APR 23	1.10	1.01
3. APR 24 - MAY 7	1.00	1.10
4. MAY 8 - MAY 21	0.80	1.00
5. MAY 22 - JUNE 4	1.00	1.07
6. JUNE 5 - JUNE 18	1.00	1.12
7. JUNE 19 - JULY 2	0.70	0.93
8. JULY 3 - JULY 16	0.70	1.24
9. JULY 17 - JULY 30	0.90	1.24
10. JUL 31 - AUG 13	0.10	NOT AVAIL
11. AUG 14 - AUG 27	0.80	0.99
12. AUG 28 - SEPT 10	0.60	1.14
13. SEPT 11 - SEPT 24	0.50	0.98
14. SEPT 26 - OCT 8	1.10	1.10
15. OCT 9 - OCT 22	0.90	1.06
16. OCT 23 - NOV 5	0.80	1.10
17. NOV 6 - NOV 19	1.00	1.05
18. NOV 20 - DEC 3	1.00	1.01
19. DEC 4 - DEC 17	1.00	1.02
20. DEC 18 - DEC 31	0.90	1.03
21. JAN 1 - JAN 14	1.00	1.02
22. JAN 15 - JAN 28	0.90	1.02
23. JAN 29 - FEB 11	0.90	1.02
24. FEB 12 - FEB 25	0.90	1.03
25. FEB 26 - MAR 10	0.90	1.06
26. MAR 11 - MAR 24	0.70	1.04
AVERAGE TO DATE	0.85	1.05
RANGE - LOW	0.10	0.93
TO DATE - HIGH	1.10	1.24
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	6	
% OUTSIDE LIMITS TO DATE	23.08%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	CARMAN	**FLUORIDATOR:**	W&T 47-050
CHEMICAL:	H_2SiF_6 25%	**OPERATOR:**	Joe Richardson
NATURAL FLUORIDE:	0.21	**TELEPHONE:**	745-2481

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.20	0.98
2. APR 10 - APR 23	1.00	1.05
3. APR 24 - MAY 7	1.00	1.05
4. MAY 8 - MAY 21	1.00	1.07
5. MAY 22 - JUNE 4	1.00	1.01
6. JUNE 5 - JUNE 18	1.00	0.98
7. JUNE 19 - JULY 2	1.10	0.94
8. JULY 3 - JULY 16	1.00	0.93
9. JULY 17 - JULY 30	1.40	0.91
10. JUL 31 - AUG 13	1.00	1.03
11. AUG 14 - AUG 27	0.60	0.76
12. AUG 28 - SEPT 10	0.70	0.84
13. SEPT 11 - SEPT 24	0.80	1.08
14. SEPT 26 - OCT 8	0.80	0.94
15. OCT 9 - OCT 22	0.60	1.00
16. OCT 23 - NOV 5	0.60	0.95
17. NOV 6 - NOV 19	0.60	0.94
18. NOV 20 - DEC 3	0.80	1.04
19. DEC 4 - DEC 17	0.60	0.95
20. DEC 18 - DEC 31	0.60	1.07
21. JAN 1 - JAN 14	0.80	1.06
22. JAN 15 - JAN 28	0.80	0.95
23. JAN 29 - FEB 11	0.70	1.22
24. FEB 12 - FEB 25	0.80	1.13
25. FEB 26 - MAR 10	0.90	1.33
26. MAR 11 - MAR 24	0.70	1.00
AVERAGE TO DATE	0.85	1.01
RANGE - LOW	0.60	0.76
TO DATE - HIGH	1.40	1.33
SAMPLES ABOVE LIMITS	1	
SAMPLES BELOW LIMITS	9	
% OUTSIDE LIMITS TO DATE	38.46%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	CHURCHILL	**FLUORIDATOR:**	Prom Gamma IV
CHEMICAL:	H_2SiF_6 25%	**OPERATOR:**	William Ayotte
NATURAL FLUORIDE:	< 0.10	**TELEPHONE:**	675-8871

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	0.80	0.45
2. APR 10 - APR 23	1.20	0.83
3. APR 24 - MAY 7	0.80	NOT AVAIL
4. MAY 8 - MAY 21	1.10	0.81
5. MAY 22 - JUNE 4	1.10	0.81
6. JUNE 5 - JUNE 18	0.80	0.34
7. JUNE 19 - JULY 2	1.00	0.51
8. JULY 3 - JULY 16	0.50	0.74
9. JULY 17 - JULY 30	0.80	1.02
10. JUL 31 - AUG 13	0.50	0.65
11. AUG 14 - AUG 27	0.50	0.55
12. AUG 28 - SEPT 10	0.40	0.60
13. SEPT 11 - SEPT 24	0.60	0.51
14. SEPT 26 - OCT 8	0.70	0.65
15. OCT 9 - OCT 22	0.80	0.60
16. OCT 23 - NOV 5	0.60	0.44
17. NOV 6 - NOV 19	1.00	0.72
18. NOV 20 - DEC 3	0.60	0.37
19. DEC 4 - DEC 17	0.70	NOT AVAIL
20. DEC 18 - DEC 31	0.90	0.99
21. JAN 1 - JAN 14	0.80	0.18
22. JAN 15 - JAN 28	0.80	0.92
23. JAN 29 - FEB 11	0.70	0.61
24. FEB 12 - FEB 25	0.80	0.81
25. FEB 26 - MAR 10	0.60	0.86
26. MAR 11 - MAR 24	0.90	0.98
AVERAGE TO DATE	0.77	0.66
RANGE - LOW	0.40	0.18
TO DATE - HIGH	1.20	1.02
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	11	
% OUTSIDE LIMITS TO DATE	42.31%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	CRANBERRY PORTAGE	**FLUORIDATOR:**	LMI A151
CHEMICAL:	NaF 4%	**OPERATOR:**	Dixie Nagy
NATURAL FLUORIDE:	0.1	**TELEPHONE:**	472-3621

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	0.80	NOT AVAIL
2. APR 10 - APR 23	3.30	1.99
3. APR 24 - MAY 7	3.60	1.79
4. MAY 8 - MAY 21	0.50	0.64
5. MAY 22 - JUNE 4	1.00	1.05
6. JUNE 5 - JUNE 18	1.20	1.05
7. JUNE 19 - JULY 2	1.10	1.02
8. JULY 3 - JULY 16	1.20	1.21
9. JULY 17 - JULY 30	1.20	1.09
10. JUL 31 - AUG 13	1.10	1.08
11. AUG 14 - AUG 27	1.10	1.03
12. AUG 28 - SEPT 10	1.10	1.05
13. SEPT 11 - SEPT 24	1.30	1.09
14. SEPT 26 - OCT 8	1.20	1.06
15. OCT 9 - OCT 22	1.20	1.08
16. OCT 23 - NOV 5	1.10	1.35
17. NOV 6 - NOV 19	1.20	1.30
18. NOV 20 - DEC 3	1.20	1.25
19. DEC 4 - DEC 17	1.10	1.25
20. DEC 18 - DEC 31	1.00	1.15
21. JAN 1 - JAN 14	1.00	1.12
22. JAN 15 - JAN 28	1.10	1.43
23. JAN 29 - FEB 11	1.00	1.17
24. FEB 12 - FEB 25	1.00	1.17
25. FEB 26 - MAR 10	0.90	1.09
26. MAR 11 - MAR 24	1.00	1.19
AVERAGE TO DATE	1.25	1.19
RANGE - LOW	0.50	0.64
TO DATE - HIGH	3.60	1.99
SAMPLES ABOVE LIMITS	3	
SAMPLES BELOW LIMITS	1	
% OUTSIDE LIMITS TO DATE	15.38%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	CROSS LAKE COMMUNITY	**FLUORIDATOR:**	LMI Saturator
CHEMICAL:	NaF 4%	**OPERATOR:**	Dwayne Settee
NATURAL FLUORIDE:	0.1	**TELEPHONE:**	676-2465

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	NOT AVAIL	NOT AVAIL
2. APR 10 - APR 23	NOT AVAIL	NOT AVAIL
3. APR 24 - MAY 7	NOT AVAIL	NOT AVAIL
4. MAY 8 - MAY 21	NOT AVAIL	NOT AVAIL
5. MAY 22 - JUNE 4	NOT AVAIL	NOT AVAIL
6. JUNE 5 - JUNE 18	NOT AVAIL	NOT AVAIL
7. JUNE 19 - JULY 2	NOT AVAIL	NOT AVAIL
8. JULY 3 - JULY 16	NOT AVAIL	NOT AVAIL
9. JULY 17 - JULY 30	NOT AVAIL	NOT AVAIL
10. JUL 31 - AUG 13	NOT AVAIL	NOT AVAIL
11. AUG 14 - AUG 27	NOT AVAIL	NOT AVAIL
12. AUG 28 - SEPT 10	NOT AVAIL	NOT AVAIL
13. SEPT 11 - SEPT 24	NOT AVAIL	NOT AVAIL
14. SEPT 26 - OCT 8	NOT AVAIL	NOT AVAIL
15. OCT 9 - OCT 22	NOT AVAIL	NOT AVAIL
16. OCT 23 - NOV 5	NOT AVAIL	NOT AVAIL
17. NOV 6 - NOV 19	NOT AVAIL	NOT AVAIL
18. NOV 20 - DEC 3	NOT AVAIL	NOT AVAIL
19. DEC 4 - DEC 17	NOT AVAIL	NOT AVAIL
20. DEC 18 - DEC 31	NOT AVAIL	NOT AVAIL
21. JAN 1 - JAN 14	NOT AVAIL	NOT AVAIL
22. JAN 15 - JAN 28	NOT AVAIL	NOT AVAIL
23. JAN 29 - FEB 11	NOT AVAIL	NOT AVAIL
24. FEB 12 - FEB 25	NOT AVAIL	NOT AVAIL
25. FEB 26 - MAR 10	NOT AVAIL	NOT AVAIL
26. MAR 11 - MAR 24	NOT AVAIL	NOT AVAIL
AVERAGE TO DATE	0.00	0.00
RANGE - LOW	0.00	0.00
TO DATE - HIGH	0.00	0.00
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	0	
% OUTSIDE LIMITS TO DATE	0.00%	
NUMBER OF SAMPLES TO DATE	0	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION: CROSS LAKE RESERVE
CHEMICAL: NaF 4%
NATURAL FLUORIDE: 0.1

FLUORIDATOI LMI Saturator
OPERATOR: Eric Blacksmith
TELEPHONE: 676-2044

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.10	1.00
2. APR 10 - APR 23	1.10	1.10
3. APR 24 - MAY 7	1.10	1.00
4. MAY 8 - MAY 21	1.00	0.90
5. MAY 22 - JUNE 4	1.00	0.90
6. JUNE 5 - JUNE 18	1.00	1.20
7. JUNE 19 - JULY 2	1.00	1.00
8. JULY 3 - JULY 16	0.90	1.00
9. JULY 17 - JULY 30	1.00	1.10
10. JUL 31 - AUG 13	0.90	1.00
11. AUG 14 - AUG 27	1.10	1.00
12. AUG 28 - SEPT 10	0.80	0.90
13. SEPT 11 - SEPT 24	1.00	1.00
14. SEPT 26 - OCT 8	1.10	0.80
15. OCT 9 - OCT 22	1.00	1.00
16. OCT 23 - NOV 5	1.00	1.10
17. NOV 6 - NOV 19	1.10	1.00
18. NOV 20 - DEC 3	1.20	1.10
19. DEC 4 - DEC 17	1.00	1.20
20. DEC 18 - DEC 31	1.10	1.10
21. JAN 1 - JAN 14	1.00	1.00
22. JAN 15 - JAN 28	1.20	1.10
23. JAN 29 - FEB 11	1.00	1.00
24. FEB 12 - FEB 25	1.10	1.10
25. FEB 26 - MAR 10	1.10	1.00
26. MAR 11 - MAR 24	1.00	0.90
AVERAGE TO DATE	1.03	1.02
RANGE - LOW	0.8	0.8
TO DATE - HIGH	1.2	1.2
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	0	
% OUTSIDE LIMITS TO DATE	0.00%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	CROSS LAKE SAGGITAWAK	**FLUORIDATOR:**	LMI Saturator
CHEMICAL:	NaF 4%	**OPERATOR:**	Jack Blacksmith
NATURAL FLUORIDE:	0.1	**TELEPHONE:**	676-2267

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	0.70	0.70
2. APR 10 - APR 23	1.00	1.05
3. APR 24 - MAY 7	0.80	0.90
4. MAY 8 - MAY 21	1.00	1.05
5. MAY 22 - JUNE 4	1.00	1.00
6. JUNE 5 - JUNE 18	0.70	0.80
7. JUNE 19 - JULY 2	1.00	1.10
8. JULY 3 - JULY 16	0.90	1.00
9. JULY 17 - JULY 30	0.60	0.70
10. JUL 31 - AUG 13	0.90	0.90
11. AUG 14 - AUG 27	1.00	1.10
12. AUG 28 - SEPT 10	0.50	0.70
13. SEPT 11 - SEPT 24	0.90	1.00
14. SEPT 26 - OCT 8	1.10	1.10
15. OCT 9 - OCT 22	1.00	1.05
16. OCT 23 - NOV 5	1.00	1.00
17. NOV 6 - NOV 19	1.00	1.00
18. NOV 20 - DEC 3	1.10	1.10
19. DEC 4 - DEC 17	1.00	1.05
20. DEC 18 - DEC 31	1.00	1.00
21. JAN 1 - JAN 14	1.00	1.10
22. JAN 15 - JAN 28	0.90	1.00
23. JAN 29 - FEB 11	0.80	0.90
24. FEB 12 - FEB 25	1.00	1.05
25. FEB 26 - MAR 10	0.80	0.90
26. MAR 11 - MAR 24	0.80	0.80
AVERAGE TO DATE	0.90	0.96
RANGE - LOW	0.5	0.7
TO DATE - HIGH	1.1	1.1
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	4	
% OUTSIDE LIMITS TO DATE	15.38%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	DAUPHIN	**FLUORIDATOR:**	W&T A690 Pac
CHEMICAL:	H_2SiF_6 25%	**OPERATOR:**	Eugene Mayuk
NATURAL FLUORIDE:	0.14	**TELEPHONE:**	638-3690

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.20	1.10
2. APR 10 - APR 23	1.10	1.01
3. APR 24 - MAY 7	1.10	1.00
4. MAY 8 - MAY 21	1.10	0.88
5. MAY 22 - JUNE 4	1.10	1.06
6. JUNE 5 - JUNE 18	1.10	1.10
7. JUNE 19 - JULY 2	1.10	1.10
8. JULY 3 - JULY 16	1.00	1.10
9. JULY 17 - JULY 30	0.80	0.84
10. JUL 31 - AUG 13	0.90	0.99
11. AUG 14 - AUG 27	0.80	0.88
12. AUG 28 - SEPT 10	0.70	1.04
13. SEPT 11 - SEPT 24	0.70	0.89
14. SEPT 26 - OCT 8	0.60	0.93
15. OCT 9 - OCT 22	0.80	0.95
16. OCT 23 - NOV 5	1.00	1.19
17. NOV 6 - NOV 19	0.90	1.19
18. NOV 20 - DEC 3	1.00	1.02
19. DEC 4 - DEC 17	1.00	1.13
20. DEC 18 - DEC 31	0.80	0.92
21. JAN 1 - JAN 14	0.80	1.04
22. JAN 15 - JAN 28	0.80	1.10
23. JAN 29 - FEB 11	0.80	1.06
24. FEB 12 - FEB 25	0.80	1.17
25. FEB 26 - MAR 10	0.90	1.08
26. MAR 11 - MAR 24	0.80	1.20
AVERAGE TO DATE	0.91	1.04
RANGE - LOW	0.60	0.84
TO DATE - HIGH	1.20	1.20
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	3	
% OUTSIDE LIMITS TO DATE	11.54%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	DELORAINE	**FLUORIDATOR:**	LMI Saturator
CHEMICAL:	NaF 4%	**OPERATOR:**	Bill Dailey
NATURAL FLUORIDE:	0.16	**TELEPHONE:**	747-2062

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	0.90	1.00
2. APR 10 - APR 23	0.70	1.01
3. APR 24 - MAY 7	0.80	0.82
4. MAY 8 - MAY 21	0.90	1.00
5. MAY 22 - JUNE 4	0.80	1.02
6. JUNE 5 - JUNE 18	0.70	0.92
7. JUNE 19 - JULY 2	0.50	0.85
8. JULY 3 - JULY 16	0.80	0.85
9. JULY 17 - JULY 30	0.80	1.02
10. JUL 31 - AUG 13	0.50	1.00
11. AUG 14 - AUG 27	0.70	0.84
12. AUG 28 - SEPT 10	0.90	1.05
13. SEPT 11 - SEPT 24	0.90	1.02
14. SEPT 26 - OCT 8	0.90	1.00
15. OCT 9 - OCT 22	0.70	1.00
16. OCT 23 - NOV 5	0.50	0.95
17. NOV 6 - NOV 19	1.00	1.00
18. NOV 20 - DEC 3	1.10	1.05
19. DEC 4 - DEC 17	0.80	0.94
20. DEC 18 - DEC 31	0.30	1.01
21. JAN 1 - JAN 14	0.60	1.01
22. JAN 15 - JAN 28	0.40	1.00
23. JAN 29 - FEB 11	0.90	1.02
24. FEB 12 - FEB 25	0.90	0.95
25. FEB 26 - MAR 10	1.00	1.00
26. MAR 11 - MAR 24	1.00	1.02
AVERAGE TO DATE	0.77	0.98
RANGE - LOW	0.30	0.82
TO DATE - HIGH	1.10	1.05
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	10	
% OUTSIDE LIMITS TO DATE	38.46%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	ERICKSON	**FLUORIDATOR:**	LMI A151
CHEMICAL:	NaF 4%	**OPERATOR:**	Ken Podruski
NATURAL FLUORIDE:	0.23	**TELEPHONE:**	636-2971

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	0.90	1.00
2. APR 10 - APR 23	1.00	0.94
3. APR 24 - MAY 7	0.90	0.92
4. MAY 8 - MAY 21	0.90	0.97
5. MAY 22 - JUNE 4	1.10	1.02
6. JUNE 5 - JUNE 18	0.80	0.96
7. JUNE 19 - JULY 2	0.90	0.99
8. JULY 3 - JULY 16	0.80	0.98
9. JULY 17 - JULY 30	1.00	1.02
10. JUL 31 - AUG 13	1.40	1.02
11. AUG 14 - AUG 27	1.00	1.07
12. AUG 28 - SEPT 10	1.00	1.16
13. SEPT 11 - SEPT 24	1.00	1.07
14. SEPT 26 - OCT 8	0.80	1.03
15. OCT 9 - OCT 22	0.90	1.11
16. OCT 23 - NOV 5	0.90	1.12
17. NOV 6 - NOV 19	1.00	1.15
18. NOV 20 - DEC 3	1.10	1.09
19. DEC 4 - DEC 17	0.90	1.04
20. DEC 18 - DEC 31	1.00	1.08
21. JAN 1 - JAN 14	1.00	1.15
22. JAN 15 - JAN 28	1.20	1.12
23. JAN 29 - FEB 11	0.90	1.08
24. FEB 12 - FEB 25	0.90	1.11
25. FEB 26 - MAR 10	0.90	1.11
26. MAR 11 - MAR 24	0.90	1.00
AVERAGE TO DATE	0.97	1.05
RANGE - LOW	0.80	0.92
TO DATE - HIGH	1.40	1.16
SAMPLES ABOVE LIMITS	1	
SAMPLES BELOW LIMITS	0	
% OUTSIDE LIMITS TO DATE	3.85%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	FLIN FLON	**FLUORIDATOR:**	Prominent
CHEMICAL:	H_2SiF_6 25%	**OPERATOR:**	Kevin Komarnicki
NATURAL FLUORIDE:	0.1	**TELEPHONE:**	687-9772

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.00	0.93
2. APR 10 - APR 23	1.00	1.00
3. APR 24 - MAY 7	1.00	1.01
4. MAY 8 - MAY 21	0.90	0.91
5. MAY 22 - JUNE 4	1.00	1.00
6. JUNE 5 - JUNE 18	1.00	0.93
7. JUNE 19 - JULY 2	1.00	0.97
8. JULY 3 - JULY 16	1.10	0.96
9. JULY 17 - JULY 30	0.90	0.94
10. JUL 31 - AUG 13	1.00	1.01
11. AUG 14 - AUG 27	0.90	0.93
12. AUG 28 - SEPT 10	1.00	1.04
13. SEPT 11 - SEPT 24	1.00	1.02
14. SEPT 26 - OCT 8	1.00	1.00
15. OCT 9 - OCT 22	1.00	0.95
16. OCT 23 - NOV 5	0.80	0.91
17. NOV 6 - NOV 19	1.00	0.98
18. NOV 20 - DEC 3	1.00	1.00
19. DEC 4 - DEC 17	1.10	0.99
20. DEC 18 - DEC 31	1.00	0.98
21. JAN 1 - JAN 14	1.00	0.98
22. JAN 15 - JAN 28	0.90	0.91
23. JAN 29 - FEB 11	0.80	0.88
24. FEB 12 - FEB 25	1.00	0.98
25. FEB 26 - MAR 10	1.00	1.02
26. MAR 11 - MAR 24	0.90	0.90
AVERAGE TO DATE	0.97	0.97
RANGE - LOW	0.80	0.88
TO DATE - HIGH	1.10	1.04
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	0	
% OUTSIDE LIMITS TO DATE	0.00%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	GILBERT PLAINS	**FLUORIDATOR:**	LMI A741
CHEMICAL:	NaF 4%	**OPERATOR:**	Lloyd Beckley
NATURAL FLUORIDE:	0.19	**TELEPHONE:**	548-2149

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.30	1.15
2. APR 10 - APR 23	1.40	1.15
3. APR 24 - MAY 7	1.00	1.15
4. MAY 8 - MAY 21	0.70	1.10
5. MAY 22 - JUNE 4	0.60	1.10
6. JUNE 5 - JUNE 18	0.30	1.10
7. JUNE 19 - JULY 2	0.30	1.10
8. JULY 3 - JULY 16	0.20	1.10
9. JULY 17 - JULY 30	0.20	1.10
10. JUL 31 - AUG 13	0.30	1.10
11. AUG 14 - AUG 27	1.10	1.05
12. AUG 28 - SEPT 10	1.20	1.05
13. SEPT 11 - SEPT 24	1.10	1.05
14. SEPT 26 - OCT 8	0.80	1.05
15. OCT 9 - OCT 22	0.60	1.05
16. OCT 23 - NOV 5	0.50	1.05
17. NOV 6 - NOV 19	1.20	1.05
18. NOV 20 - DEC 3	1.40	1.05
19. DEC 4 - DEC 17	NOT AVAIL	NOT AVAIL
20. DEC 18 - DEC 31	1.00	1.05
21. JAN 1 - JAN 14	0.70	1.05
22. JAN 15 - JAN 28	0.60	1.05
23. JAN 29 - FEB 11	0.40	1.05
24. FEB 12 - FEB 25	0.70	1.05
25. FEB 26 - MAR 10	1.20	1.05
26. MAR 11 - MAR 24	1.40	1.05
AVERAGE TO DATE	0.81	1.08
RANGE - LOW	0.20	1.05
TO DATE - HIGH	1.40	1.15
SAMPLES ABOVE LIMITS	4	
SAMPLES BELOW LIMITS	13	
% OUTSIDE LIMITS TO DATE	68.00%	
NUMBER OF SAMPLES TO DATE	25	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	GILLAM	**FLUORIDATOR:**	W&T
CHEMICAL:	H_2SiF_6 25%	**OPERATOR:**	John McDonald
NATURAL FLUORIDE:	0.1	**TELEPHONE:**	652-2377

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	0.80	0.72
2. APR 10 - APR 23	1.20	0.74
3. APR 24 - MAY 7	1.10	0.70
4. MAY 8 - MAY 21	1.10	NOT AVAIL
5. MAY 22 - JUNE 4	1.20	0.91
6. JUNE 5 - JUNE 18	1.20	0.85
7. JUNE 19 - JULY 2	1.40	0.92
8. JULY 3 - JULY 16	1.50	0.87
9. JULY 17 - JULY 30	0.90	1.30
10. JUL 31 - AUG 13	0.70	0.99
11. AUG 14 - AUG 27	0.60	0.74
12. AUG 28 - SEPT 10	0.80	1.00
13. SEPT 11 - SEPT 24	1.00	0.94
14. SEPT 26 - OCT 8	1.00	0.97
15. OCT 9 - OCT 22	1.20	1.14
16. OCT 23 - NOV 5	1.20	1.21
17. NOV 6 - NOV 19	1.20	1.30
18. NOV 20 - DEC 3	1.40	NOT AVAIL
19. DEC 4 - DEC 17	1.20	1.16
20. DEC 18 - DEC 31	1.10	1.16
21. JAN 1 - JAN 14	1.00	1.16
22. JAN 15 - JAN 28	1.00	0.69
23. JAN 29 - FEB 11	1.00	0.88
24. FEB 12 - FEB 25	1.10	0.88
25. FEB 26 - MAR 10	1.10	0.97
26. MAR 11 - MAR 24	1.00	1.02
AVERAGE TO DATE	1.08	0.00
RANGE - LOW	0.60	0.69
TO DATE - HIGH	1.50	1.30
SAMPLES ABOVE LIMITS	3	
SAMPLES BELOW LIMITS	2	
% OUTSIDE LIMITS TO DATE	19.23%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	GIMLI (TOWN)	**FLUORIDATOR:**	Myers
CHEMICAL:	NaF 4%	**OPERATOR:**	Baldur Gudbjartson
NATURAL FLUORIDE:	0.45	**TELEPHONE:**	642-7443

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.10	1.00
2. APR 10 - APR 23	0.90	1.00
3. APR 24 - MAY 7	1.10	1.00
4. MAY 8 - MAY 21	1.00	1.00
5. MAY 22 - JUNE 4	1.10	1.00
6. JUNE 5 - JUNE 18	1.10	1.00
7. JUNE 19 - JULY 2	1.00	1.00
8. JULY 3 - JULY 16	0.90	0.71
9. JULY 17 - JULY 30	0.90	0.91
10. JUL 31 - AUG 13	1.00	1.00
11. AUG 14 - AUG 27	1.10	0.92
12. AUG 28 - SEPT 10	0.90	0.99
13. SEPT 11 - SEPT 24	1.00	1.04
14. SEPT 26 - OCT 8	1.00	0.96
15. OCT 9 - OCT 22	1.10	1.04
16. OCT 23 - NOV 5	0.70	0.76
17. NOV 6 - NOV 19	NOT AVAIL	NOT AVAIL
18. NOV 20 - DEC 3	NOT AVAIL	NOT AVAIL
19. DEC 4 - DEC 17	NOT AVAIL	NOT AVAIL
20. DEC 18 - DEC 31	NOT AVAIL	NOT AVAIL
21. JAN 1 - JAN 14	NOT AVAIL	NOT AVAIL
22. JAN 15 - JAN 28	NOT AVAIL	NOT AVAIL
23. JAN 29 - FEB 11	NOT AVAIL	NOT AVAIL
24. FEB 12 - FEB 25	1.00	0.98
25. FEB 26 - MAR 10	1.00	0.67
26. MAR 11 - MAR 24	1.10	0.95
AVERAGE TO DATE	0.99	0.94
RANGE - LOW	0.70	0.67
TO DATE - HIGH	1.10	1.04
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	1	
% OUTSIDE LIMITS TO DATE	5.26%	
NUMBER OF SAMPLES TO DATE	19	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	GIMLI INDUSTRIAL PARK	**FLUORIDATOR:**	W&T A747
CHEMICAL:	NaF 4%	**OPERATOR:**	Richard Bezdietny
NATURAL FLUORIDE:	0.43	**TELEPHONE:**	642-5297

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.00	1.06
2. APR 10 - APR 23	1.00	1.01
3. APR 24 - MAY 7	0.90	0.96
4. MAY 8 - MAY 21	0.70	0.97
5. MAY 22 - JUNE 4	1.00	1.05
6. JUNE 5 - JUNE 18	1.00	1.03
7. JUNE 19 - JULY 2	1.00	1.02
8. JULY 3 - JULY 16	1.00	0.96
9. JULY 17 - JULY 30	0.90	1.01
10. JUL 31 - AUG 13	1.00	1.02
11. AUG 14 - AUG 27	1.00	0.95
12. AUG 28 - SEPT 10	0.80	0.90
13. SEPT 11 - SEPT 24	1.00	1.00
14. SEPT 26 - OCT 8	1.00	0.92
15. OCT 9 - OCT 22	1.00	1.01
16. OCT 23 - NOV 5	0.90	1.02
17. NOV 6 - NOV 19	1.00	1.02
18. NOV 20 - DEC 3	1.00	0.92
19. DEC 4 - DEC 17	0.90	0.90
20. DEC 18 - DEC 31	0.90	0.90
21. JAN 1 - JAN 14	1.10	1.01
22. JAN 15 - JAN 28	1.00	1.01
23. JAN 29 - FEB 11	1.00	1.04
24. FEB 12 - FEB 25	1.10	1.01
25. FEB 26 - MAR 10	0.90	0.95
26. MAR 11 - MAR 24	0.80	0.92
AVERAGE TO DATE	0.96	0.98
RANGE - LOW TO DATE - HIGH	0.70 1.10	0.90 1.06
SAMPLES ABOVE LIMITS SAMPLES BELOW LIMITS	0 1	
% OUTSIDE LIMITS TO DATE	3.85%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	GLADSTONE	**FLUORIDATOR:**	W&T A745
CHEMICAL:	NaF 4%	**OPERATOR:**	Wayne Sheridan
NATURAL FLUORIDE:	0.22	**TELEPHONE:**	385-2917

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.30	0.99
2. APR 10 - APR 23	1.10	0.90
3. APR 24 - MAY 7	1.20	1.04
4. MAY 8 - MAY 21	1.00	0.95
5. MAY 22 - JUNE 4	1.00	1.01
6. JUNE 5 - JUNE 18	1.10	1.10
7. JUNE 19 - JULY 2	1.10	0.97
8. JULY 3 - JULY 16	1.00	1.04
9. JULY 17 - JULY 30	0.80	1.03
10. JUL 31 - AUG 13	0.90	0.97
11. AUG 14 - AUG 27	0.90	0.83
12. AUG 28 - SEPT 10	1.00	0.94
13. SEPT 11 - SEPT 24	0.80	0.94
14. SEPT 26 - OCT 8	0.90	0.94
15. OCT 9 - OCT 22	1.10	0.92
16. OCT 23 - NOV 5	1.00	0.90
17. NOV 6 - NOV 19	1.00	1.02
18. NOV 20 - DEC 3	1.00	1.11
19. DEC 4 - DEC 17	1.00	1.14
20. DEC 18 - DEC 31	1.00	1.04
21. JAN 1 - JAN 14	1.00	1.10
22. JAN 15 - JAN 28	1.00	1.17
23. JAN 29 - FEB 11	0.90	1.08
24. FEB 12 - FEB 25	1.40	1.04
25. FEB 26 - MAR 10	1.00	1.02
26. MAR 11 - MAR 24	1.00	0.96
AVERAGE TO DATE	1.02	1.01
RANGE - LOW	0.80	0.83
TO DATE - HIGH	1.40	1.17
SAMPLES ABOVE LIMITS	2	
SAMPLES BELOW LIMITS	0	
% OUTSIDE LIMITS TO DATE	7.69%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	GRISWOLD SIOUX VALLEY BAND	**FLUORIDATOR:**	
CHEMICAL:	NaF 4%	**OPERATOR:**	Avin Dowan
NATURAL FLUORIDE:	0.10	**TELEPHONE:**	855-2690

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	NOT AVAIL	NOT AVAIL
2. APR 10 - APR 23	NOT AVAIL	NOT AVAIL
3. APR 24 - MAY 7	NOT AVAIL	NOT AVAIL
4. MAY 8 - MAY 21	NOT AVAIL	NOT AVAIL
5. MAY 22 - JUNE 4	NOT AVAIL	NOT AVAIL
6. JUNE 5 - JUNE 18	NOT AVAIL	NOT AVAIL
7. JUNE 19 - JULY 2	NOT AVAIL	NOT AVAIL
8. JULY 3 - JULY 16	NOT AVAIL	NOT AVAIL
9. JULY 17 - JULY 30	NOT AVAIL	NOT AVAIL
10. JUL 31 - AUG 13	NOT AVAIL	NOT AVAIL
11. AUG 14 - AUG 27	NOT AVAIL	NOT AVAIL
12. AUG 28 - SEPT 10	NOT AVAIL	NOT AVAIL
13. SEPT 11 - SEPT 24	NOT AVAIL	NOT AVAIL
14. SEPT 26 - OCT 8	NOT AVAIL	NOT AVAIL
15. OCT 9 - OCT 22	NOT AVAIL	NOT AVAIL
16. OCT 23 - NOV 5	NOT AVAIL	NOT AVAIL
17. NOV 6 - NOV 19	NOT AVAIL	NOT AVAIL
18. NOV 20 - DEC 3	1.20	NOT AVAIL
19. DEC 4 - DEC 17	1.10	NOT AVAIL
20. DEC 18 - DEC 31	15.10	NOT AVAIL
21. JAN 1 - JAN 14	0.80	NOT AVAIL
22. JAN 15 - JAN 28	1.20	NOT AVAIL
23. JAN 29 - FEB 11	5.60	NOT AVAIL
24. FEB 12 - FEB 25	12.60	NOT AVAIL
25. FEB 26 - MAR 10	0.60	NOT AVAIL
26. MAR 11 - MAR 24	NOT AVAIL	NOT AVAIL
AVERAGE TO DATE	4.78	0.00
RANGE - LOW	0.60	0.00
TO DATE - HIGH	15.10	0.00
SAMPLES ABOVE LIMITS	3	
SAMPLES BELOW LIMITS	1	
% OUTSIDE LIMITS TO DATE	50.00%	
NUMBER OF SAMPLES TO DATE	8	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	HAMIOTA	**FLUORIDATOR:**	LMI A751
CHEMICAL:	NaF 4%	**OPERATOR:**	Brian Park
NATURAL FLUORIDE:	0.29	**TELEPHONE:**	764-2531

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.10	0.80
2. APR 10 - APR 23	1.30	0.90
3. APR 24 - MAY 7	1.20	0.60
4. MAY 8 - MAY 21	1.10	0.70
5. MAY 22 - JUNE 4	0.90	0.60
6. JUNE 5 - JUNE 18	1.00	0.90
7. JUNE 19 - JULY 2	1.10	1.20
8. JULY 3 - JULY 16	0.70	0.50
9. JULY 17 - JULY 30	0.90	0.70
10. JUL 31 - AUG 13	1.00	0.60
11. AUG 14 - AUG 27	1.00	0.80
12. AUG 28 - SEPT 10	0.90	0.60
13. SEPT 11 - SEPT 24	1.00	0.80
14. SEPT 26 - OCT 8	1.00	0.80
15. OCT 9 - OCT 22	1.00	0.70
16. OCT 23 - NOV 5	0.80	1.60
17. NOV 6 - NOV 19	0.90	0.90
18. NOV 20 - DEC 3	1.10	1.30
19. DEC 4 - DEC 17	1.00	0.50
20. DEC 18 - DEC 31	0.90	0.70
21. JAN 1 - JAN 14	1.00	0.80
22. JAN 15 - JAN 28	1.00	1.50
23. JAN 29 - FEB 11	0.90	0.50
24. FEB 12 - FEB 25	0.60	0.80
25. FEB 26 - MAR 10	NOT AVAIL	NOT AVAIL
26. MAR 11 - MAR 24	1.00	0.80
AVERAGE TO DATE	0.98	0.82
RANGE - LOW	0.60	0.50
TO DATE - HIGH	1.30	1.60
SAMPLES ABOVE LIMITS	1	
SAMPLES BELOW LIMITS	2	
% OUTSIDE LIMITS TO DATE	12.00%	
NUMBER OF SAMPLES TO DATE	25	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	HARTNEY	**FLUORIDATOR:**	LMI A741
CHEMICAL:	NaF 4%	**OPERATOR:**	Greg Morrison
NATURAL FLUORIDE:	0.2	**TELEPHONE:**	858-2076

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.20	1.10
2. APR 10 - APR 23	1.20	1.10
3. APR 24 - MAY 7	1.00	1.00
4. MAY 8 - MAY 21	0.70	1.00
5. MAY 22 - JUNE 4	0.80	1.00
6. JUNE 5 - JUNE 18	0.80	0.95
7. JUNE 19 - JULY 2	0.90	1.00
8. JULY 3 - JULY 16	1.00	1.00
9. JULY 17 - JULY 30	0.80	0.95
10. JUL 31 - AUG 13	1.20	1.10
11. AUG 14 - AUG 27	1.20	1.10
12. AUG 28 - SEPT 10	1.10	1.05
13. SEPT 11 - SEPT 24	0.80	0.95
14. SEPT 26 - OCT 8	1.00	1.00
15. OCT 9 - OCT 22	1.10	1.10
16. OCT 23 - NOV 5	0.90	1.05
17. NOV 6 - NOV 19	0.80	0.95
18. NOV 20 - DEC 3	0.80	0.95
19. DEC 4 - DEC 17	0.90	1.05
20. DEC 18 - DEC 31	0.80	1.00
21. JAN 1 - JAN 14	0.90	0.95
22. JAN 15 - JAN 28	1.20	1.10
23. JAN 29 - FEB 11	1.10	1.10
24. FEB 12 - FEB 25	1.10	1.05
25. FEB 26 - MAR 10	1.00	1.00
26. MAR 11 - MAR 24	0.90	1.00
AVERAGE TO DATE	0.97	1.02
RANGE - LOW	0.70	0.95
TO DATE - HIGH	1.20	1.10
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	1	
% OUTSIDE LIMITS TO DATE	3.85%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	KILLARNEY	**FLUORIDATOR:**	LMI B721
CHEMICAL:	NaF 4%	**OPERATOR:**	Carl Parker
NATURAL FLUORIDE:	0.19	**TELEPHONE:**	523-8944

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.60	1.00
2. APR 10 - APR 23	1.30	0.90
3. APR 24 - MAY 7	1.40	1.20
4. MAY 8 - MAY 21	1.20	0.90
5. MAY 22 - JUNE 4	1.10	0.80
6. JUNE 5 - JUNE 18	1.70	0.80
7. JUNE 19 - JULY 2	1.40	0.90
8. JULY 3 - JULY 16	1.80	1.10
9. JULY 17 - JULY 30	1.30	0.40
10. JUL 31 - AUG 13	2.30	1.10
11. AUG 14 - AUG 27	1.80	1.00
12. AUG 28 - SEPT 10	2.00	1.10
13. SEPT 11 - SEPT 24	3.60	1.20
14. SEPT 26 - OCT 8	3.00	1.40
15. OCT 9 - OCT 22	2.10	1.10
16. OCT 23 - NOV 5	2.10	0.90
17. NOV 6 - NOV 19	2.30	1.00
18. NOV 20 - DEC 3	2.20	0.90
19. DEC 4 - DEC 17	1.60	1.00
20. DEC 18 - DEC 31	1.40	1.20
21. JAN 1 - JAN 14	2.70	1.50
22. JAN 15 - JAN 28	1.70	1.20
23. JAN 29 - FEB 11	1.60	1.20
24. FEB 12 - FEB 25	1.50	1.10
25. FEB 26 - MAR 10	2.20	0.70
26. MAR 11 - MAR 24	2.10	0.60
AVERAGE TO DATE	1.88	1.01
RANGE - LOW	1.10	0.40
TO DATE - HIGH	3.60	1.50
SAMPLES ABOVE LIMITS	24	
SAMPLES BELOW LIMITS	0	
% OUTSIDE LIMITS TO DATE	92.31%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	LAC DU BONNET	**FLUORIDATOR:**	LMI Saturator
CHEMICAL:	NaF 4%	**OPERATOR:**	Al Simcoe
NATURAL FLUORIDE:	0.1	**TELEPHONE:**	345-8766

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	0.80	1.14
2. APR 10 - APR 23	1.10	1.11
3. APR 24 - MAY 7	1.10	1.15
4. MAY 8 - MAY 21	1.10	1.11
5. MAY 22 - JUNE 4	1.20	1.00
6. JUNE 5 - JUNE 18	1.20	1.14
7. JUNE 19 - JULY 2	NOT AVAIL	NOT AVAIL
8. JULY 3 - JULY 16	0.80	0.88
9. JULY 17 - JULY 30	1.10	1.14
10. JUL 31 - AUG 13	1.80	0.99
11. AUG 14 - AUG 27	1.10	1.18
12. AUG 28 - SEPT 10	0.90	1.07
13. SEPT 11 - SEPT 24	0.40	1.13
14. SEPT 26 - OCT 8	1.00	1.03
15. OCT 9 - OCT 22	0.80	1.15
16. OCT 23 - NOV 5	0.80	1.01
17. NOV 6 - NOV 19	0.60	0.91
18. NOV 20 - DEC 3	1.10	1.16
19. DEC 4 - DEC 17	0.90	1.13
20. DEC 18 - DEC 31	1.00	1.19
21. JAN 1 - JAN 14	1.00	0.96
22. JAN 15 - JAN 28	0.90	1.09
23. JAN 29 - FEB 11	0.70	0.90
24. FEB 12 - FEB 25	1.00	0.90
25. FEB 26 - MAR 10	1.10	0.96
26. MAR 11 - MAR 24	1.00	1.12
AVERAGE TO DATE	0.98	1.06
RANGE - LOW TO DATE - HIGH	0.40 1.80	0.88 1.19
SAMPLES ABOVE LIMITS SAMPLES BELOW LIMITS	1 3	
% OUTSIDE LIMITS TO DATE	16.00%	
NUMBER OF SAMPLES TO DATE	25	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	LETELLIER	**FLUORIDATOR:**	LMI
CHEMICAL:	H_2SiF_6 25%	**OPERATOR:**	Jack Cronk
NATURAL FLUORIDE:	0.17	**TELEPHONE:**	737-2265

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.10	1.17
2. APR 10 - APR 23	1.20	1.14
3. APR 24 - MAY 7	1.10	1.10
4. MAY 8 - MAY 21	1.00	1.14
5. MAY 22 - JUNE 4	1.00	1.13
6. JUNE 5 - JUNE 18	1.00	1.13
7. JUNE 19 - JULY 2	1.00	1.08
8. JULY 3 - JULY 16	1.10	1.08
9. JULY 17 - JULY 30	1.00	1.12
10. JUL 31 - AUG 13	0.90	1.06
11. AUG 14 - AUG 27	1.00	1.03
12. AUG 28 - SEPT 10	1.00	1.03
13. SEPT 11 - SEPT 24	1.00	1.05
14. SEPT 26 - OCT 8	1.10	1.04
15. OCT 9 - OCT 22	1.00	1.03
16. OCT 23 - NOV 5	1.00	1.05
17. NOV 6 - NOV 19	0.90	1.02
18. NOV 20 - DEC 3	1.00	1.01
19. DEC 4 - DEC 17	1.00	1.01
20. DEC 18 - DEC 31	1.00	1.07
21. JAN 1 - JAN 14	1.10	1.05
22. JAN 15 - JAN 28	1.10	1.07
23. JAN 29 - FEB 11	1.20	1.17
24. FEB 12 - FEB 25	1.20	1.17
25. FEB 26 - MAR 10	1.20	1.17
26. MAR 11 - MAR 24	1.20	1.23
AVERAGE TO DATE	1.05	1.09
RANGE - LOW	0.90	1.01
TO DATE - HIGH	1.20	1.23
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	0	
% OUTSIDE LIMITS TO DATE	0.00%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	LONG PLAIN	**FLUORIDATOR:**	LMI Saturator
CHEMICAL:	NaF 4%	**OPERATOR:**	Morris Peters
NATURAL FLUORIDE:	0.23	**TELEPHONE:**	252-2094

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.10	1.10
2. APR 10 - APR 23	1.20	0.85
3. APR 24 - MAY 7	1.40	0.90
4. MAY 8 - MAY 21	0.80	0.72
5. MAY 22 - JUNE 4	1.20	1.19
6. JUNE 5 - JUNE 18	1.30	NOT AVAIL
7. JUNE 19 - JULY 2	1.10	0.88
8. JULY 3 - JULY 16	1.20	1.22
9. JULY 17 - JULY 30	1.20	NOT AVAIL
10. JUL 31 - AUG 13	1.10	1.20
11. AUG 14 - AUG 27	1.20	1.00
12. AUG 28 - SEPT 10	1.00	1.07
13. SEPT 11 - SEPT 24	1.30	1.09
14. SEPT 26 - OCT 8	1.10	0.95
15. OCT 9 - OCT 22	1.30	0.75
16. OCT 23 - NOV 5	1.10	0.93
17. NOV 6 - NOV 19	1.10	1.18
18. NOV 20 - DEC 3	1.30	0.90
19. DEC 4 - DEC 17	1.20	0.80
20. DEC 18 - DEC 31	1.00	1.17
21. JAN 1 - JAN 14	1.00	1.18
22. JAN 15 - JAN 28	1.10	1.07
23. JAN 29 - FEB 11	NOT AVAIL	NOT AVAIL
24. FEB 12 - FEB 25	0.90	0.94
25. FEB 26 - MAR 10	1.10	0.88
26. MAR 11 - MAR 24	1.00	1.05
AVERAGE TO DATE	1.13	1.00
RANGE - LOW TO DATE - HIGH	0.80 1.40	0.72 1.22
SAMPLES ABOVE LIMITS SAMPLES BELOW LIMITS	5 0	
% OUTSIDE LIMITS TO DATE	20.00%	
NUMBER OF SAMPLES TO DATE	25	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	McCREARY	**FLUORIDATOR:**	LMI A151
CHEMICAL:	NaF 4%	**OPERATOR:**	John McLean
NATURAL FLUORIDE:	0.24	**TELEPHONE:**	835-2544

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.00	0.97
2. APR 10 - APR 23	1.00	0.99
3. APR 24 - MAY 7	0.40	NOT AVAIL
4. MAY 8 - MAY 21	0.30	NOT AVAIL
5. MAY 22 - JUNE 4	1.00	1.00
6. JUNE 5 - JUNE 18	0.90	1.00
7. JUNE 19 - JULY 2	0.80	1.00
8. JULY 3 - JULY 16	0.80	0.98
9. JULY 17 - JULY 30	0.80	1.00
10. JUL 31 - AUG 13	0.90	1.01
11. AUG 14 - AUG 27	1.00	1.01
12. AUG 28 - SEPT 10	0.90	1.01
13. SEPT 11 - SEPT 24	0.80	1.00
14. SEPT 26 - OCT 8	0.80	NOT AVAIL
15. OCT 9 - OCT 22	0.80	0.98
16. OCT 23 - NOV 5	1.10	0.99
17. NOV 6 - NOV 19	0.80	0.97
18. NOV 20 - DEC 3	0.90	NOT AVAIL
19. DEC 4 - DEC 17	0.90	1.00
20. DEC 18 - DEC 31	NOT AVAIL	NOT AVAIL
21. JAN 1 - JAN 14	0.80	0.99
22. JAN 15 - JAN 28	1.00	1.00
23. JAN 29 - FEB 11	0.90	1.00
24. FEB 12 - FEB 25	0.80	0.98
25. FEB 26 - MAR 10	1.00	1.00
26. MAR 11 - MAR 24	0.90	0.97
AVERAGE TO DATE	0.85	0.99
RANGE - LOW	0.30	0.97
TO DATE - HIGH	1.10	1.01
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	2	
% OUTSIDE LIMITS TO DATE	8.00%	
NUMBER OF SAMPLES TO DATE	25	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	MANITOU	**FLUORIDATOR:**	LMI Saturator
CHEMICAL:	NaF 4%	**OPERATOR:**	Bob Barrett
NATURAL FLUORIDE:	0.19	**TELEPHONE:**	242-2885

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.00	1.18
2. APR 10 - APR 23	1.00	1.14
3. APR 24 - MAY 7	1.00	1.15
4. MAY 8 - MAY 21	0.90	1.15
5. MAY 22 - JUNE 4	1.00	1.12
6. JUNE 5 - JUNE 18	1.00	1.18
7. JUNE 19 - JULY 2	1.00	1.18
8. JULY 3 - JULY 16	1.10	1.18
9. JULY 17 - JULY 30	1.00	1.11
10. JUL 31 - AUG 13	0.80	1.04
11. AUG 14 - AUG 27	1.20	1.21
12. AUG 28 - SEPT 10	1.00	1.19
13. SEPT 11 - SEPT 24	1.10	1.19
14. SEPT 26 - OCT 8	1.00	1.18
15. OCT 9 - OCT 22	0.90	1.11
16. OCT 23 - NOV 5	1.20	1.21
17. NOV 6 - NOV 19	1.20	1.22
18. NOV 20 - DEC 3	1.10	1.18
19. DEC 4 - DEC 17	1.10	1.20
20. DEC 18 - DEC 31	1.00	1.18
21. JAN 1 - JAN 14	1.10	1.19
22. JAN 15 - JAN 28	1.00	1.22
23. JAN 29 - FEB 11	1.00	1.19
24. FEB 12 - FEB 25	1.00	1.18
25. FEB 26 - MAR 10	1.00	1.20
26. MAR 11 - MAR 24	1.00	1.19
AVERAGE TO DATE	1.03	1.17
RANGE - LOW	0.80	1.04
TO DATE - HIGH	1.20	1.22
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	0	
% OUTSIDE LIMITS TO DATE	0.00%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	MELITA	**FLUORIDATOR:**	W&T Saturator
CHEMICAL:	NaF 4%	**OPERATOR:**	Bob Reddaway
NATURAL FLUORIDE:	0.18	**TELEPHONE:**	522-3413

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	0.90	1.00
2. APR 10 - APR 23	0.90	0.90
3. APR 24 - MAY 7	0.80	0.95
4. MAY 8 - MAY 21	0.70	1.00
5. MAY 22 - JUNE 4	0.80	0.90
6. JUNE 5 - JUNE 18	1.20	1.00
7. JUNE 19 - JULY 2	0.90	0.95
8. JULY 3 - JULY 16	0.90	0.95
9. JULY 17 - JULY 30	0.90	0.90
10. JUL 31 - AUG 13	0.80	0.95
11. AUG 14 - AUG 27	0.90	1.00
12. AUG 28 - SEPT 10	0.80	0.95
13. SEPT 11 - SEPT 24	0.80	0.95
14. SEPT 26 - OCT 8	0.80	0.90
15. OCT 9 - OCT 22	1.20	1.00
16. OCT 23 - NOV 5	1.00	0.95
17. NOV 6 - NOV 19	0.90	1.00
18. NOV 20 - DEC 3	1.00	1.05
19. DEC 4 - DEC 17	1.00	0.95
20. DEC 18 - DEC 31	1.00	1.00
21. JAN 1 - JAN 14	1.50	0.95
22. JAN 15 - JAN 28	1.00	1.00
23. JAN 29 - FEB 11	1.00	1.00
24. FEB 12 - FEB 25	1.00	1.00
25. FEB 26 - MAR 10	1.00	1.00
26. MAR 11 - MAR 24	0.90	0.95
AVERAGE TO DATE	0.95	0.97
RANGE - LOW TO DATE - HIGH	0.70 1.50	0.9 1.05
SAMPLES ABOVE LIMITS SAMPLES BELOW LIMITS	1 1	
% OUTSIDE LIMITS TO DATE	7.69%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	MINNEDOSA	**FLUORIDATOR:**	Prominent
CHEMICAL:	H_2SiF_6 25%	**OPERATOR:**	Allan Jamieson
NATURAL FLUORIDE:	0.28	**TELEPHONE:**	867-2949

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	0.70	1.00
2. APR 10 - APR 23	1.40	1.10
3. APR 24 - MAY 7	1.10	1.15
4. MAY 8 - MAY 21	1.10	1.20
5. MAY 22 - JUNE 4	NOT AVAIL	NOT AVAIL
6. JUNE 5 - JUNE 18	1.10	1.10
7. JUNE 19 - JULY 2	1.00	1.10
8. JULY 3 - JULY 16	NOT AVAIL	NOT AVAIL
9. JULY 17 - JULY 30	NOT AVAIL	NOT AVAIL
10. JUL 31 - AUG 13	1.00	1.00
11. AUG 14 - AUG 27	1.00	1.10
12. AUG 28 - SEPT 10	NOT AVAIL	NOT AVAIL
13. SEPT 11 - SEPT 24	1.00	1.00
14. SEPT 26 - OCT 8	0.90	1.00
15. OCT 9 - OCT 22	1.30	1.20
16. OCT 23 - NOV 5	1.30	1.20
17. NOV 6 - NOV 19	1.30	1.10
18. NOV 20 - DEC 3	1.10	1.00
19. DEC 4 - DEC 17	1.00	1.00
20. DEC 18 - DEC 31	1.00	1.00
21. JAN 1 - JAN 14	1.00	1.00
22. JAN 15 - JAN 28	1.00	1.05
23. JAN 29 - FEB 11	1.10	1.00
24. FEB 12 - FEB 25	1.00	1.05
25. FEB 26 - MAR 10	1.10	1.00
26. MAR 11 - MAR 24	1.00	1.00
AVERAGE TO DATE	1.07	1.06
RANGE - LOW	0.70	1.00
TO DATE - HIGH	1.40	1.20
SAMPLES ABOVE LIMITS	4	
SAMPLES BELOW LIMITS	1	
% OUTSIDE LIMITS TO DATE	22.73%	
NUMBER OF SAMPLES TO DATE	22	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	MORDEN	**FLUORIDATOR:**	Prominent
CHEMICAL:	H_2SiF_6 25%	**OPERATOR:**	Larry Benoit
NATURAL FLUORIDE:	0.32	**TELEPHONE:**	822-5707

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.00	1.20
2. APR 10 - APR 23	1.10	1.10
3. APR 24 - MAY 7	1.00	1.10
4. MAY 8 - MAY 21	0.90	1.00
5. MAY 22 - JUNE 4	1.00	1.10
6. JUNE 5 - JUNE 18	1.00	1.00
7. JUNE 19 - JULY 2	0.90	1.10
8. JULY 3 - JULY 16	0.90	1.00
9. JULY 17 - JULY 30	0.90	1.10
10. JUL 31 - AUG 13	0.90	0.90
11. AUG 14 - AUG 27	1.10	1.00
12. AUG 28 - SEPT 10	0.90	1.00
13. SEPT 11 - SEPT 24	0.90	0.90
14. SEPT 26 - OCT 8	0.90	0.80
15. OCT 9 - OCT 22	0.80	0.80
16. OCT 23 - NOV 5	0.90	0.80
17. NOV 6 - NOV 19	0.70	0.70
18. NOV 20 - DEC 3	1.00	0.80
19. DEC 4 - DEC 17	0.80	0.80
20. DEC 18 - DEC 31	0.90	0.80
21. JAN 1 - JAN 14	0.90	0.90
22. JAN 15 - JAN 28	0.90	0.80
23. JAN 29 - FEB 11	0.90	0.90
24. FEB 12 - FEB 25	0.90	0.90
25. FEB 26 - MAR 10	1.10	0.80
26. MAR 11 - MAR 24	1.00	1.10
AVERAGE TO DATE	0.93	0.94
RANGE - LOW	0.70	0.70
TO DATE - HIGH	1.10	1.20
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	1	
% OUTSIDE LIMITS TO DATE	3.85%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	MORRIS	**FLUORIDATOR:**	Prominent
CHEMICAL:	H_2SiF_6 25%	**OPERATOR:**	Richard Dupuis
NATURAL FLUORIDE:	0.22	**TELEPHONE:**	746-2790

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.10	0.80
2. APR 10 - APR 23	1.30	0.99
3. APR 24 - MAY 7	1.40	1.10
4. MAY 8 - MAY 21	1.20	1.00
5. MAY 22 - JUNE 4	1.00	0.85
6. JUNE 5 - JUNE 18	0.90	0.95
7. JUNE 19 - JULY 2	1.00	0.97
8. JULY 3 - JULY 16	1.00	0.94
9. JULY 17 - JULY 30	1.00	0.92
10. JUL 31 - AUG 13	1.00	1.00
11. AUG 14 - AUG 27	1.00	1.00
12. AUG 28 - SEPT 10	1.00	1.12
13. SEPT 11 - SEPT 24	0.80	0.88
14. SEPT 26 - OCT 8	1.10	1.00
15. OCT 9 - OCT 22	1.10	1.03
16. OCT 23 - NOV 5	1.10	1.20
17. NOV 6 - NOV 19	0.90	0.96
18. NOV 20 - DEC 3	0.90	1.02
19. DEC 4 - DEC 17	0.80	0.95
20. DEC 18 - DEC 31	0.80	0.85
21. JAN 1 - JAN 14	0.90	0.95
22. JAN 15 - JAN 28	0.90	1.06
23. JAN 29 - FEB 11	0.80	1.10
24. FEB 12 - FEB 25	0.90	0.97
25. FEB 26 - MAR 10	0.80	1.09
26. MAR 11 - MAR 24	0.80	1.10
AVERAGE TO DATE	0.98	0.99
RANGE - LOW TO DATE - HIGH	0.80 1.40	0.80 1.20
SAMPLES ABOVE LIMITS SAMPLES BELOW LIMITS	2 0	
% OUTSIDE LIMITS TO DATE	7.69%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	NEEPAWA	**FLUORIDATOR:**	W&T A690
CHEMICAL:	Na_2SiF_6 (Dry)	**OPERATOR:**	George Squires
NATURAL FLUORIDE:	0.24	**TELEPHONE:**	476-5331

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	0.80	1.00
2. APR 10 - APR 23	1.00	0.82
3. APR 24 - MAY 7	0.80	0.87
4. MAY 8 - MAY 21	0.70	1.00
5. MAY 22 - JUNE 4	0.90	0.91
6. JUNE 5 - JUNE 18	1.00	0.93
7. JUNE 19 - JULY 2	0.90	0.91
8. JULY 3 - JULY 16	1.00	1.04
9. JULY 17 - JULY 30	0.80	1.00
10. JUL 31 - AUG 13	1.00	0.96
11. AUG 14 - AUG 27	0.80	0.97
12. AUG 28 - SEPT 10	0.90	0.99
13. SEPT 11 - SEPT 24	0.80	0.99
14. SEPT 26 - OCT 8	0.90	0.86
15. OCT 9 - OCT 22	0.80	0.93
16. OCT 23 - NOV 5	0.90	1.11
17. NOV 6 - NOV 19	0.70	0.97
18. NOV 20 - DEC 3	0.80	1.16
19. DEC 4 - DEC 17	0.50	1.08
20. DEC 18 - DEC 31	0.60	0.95
21. JAN 1 - JAN 14	0.70	0.94
22. JAN 15 - JAN 28	0.80	0.91
23. JAN 29 - FEB 11	NOT AVAIL	NOT AVAIL
24. FEB 12 - FEB 25	1.00	1.17
25. FEB 26 - MAR 10	1.10	0.94
26. MAR 11 - MAR 24	1.00	1.15
AVERAGE TO DATE	0.85	0.98
RANGE - LOW	0.50	0.82
TO DATE - HIGH	1.10	1.17
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	5	
% OUTSIDE LIMITS TO DATE	20.00%	
NUMBER OF SAMPLES TO DATE	25	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	NORWAY HOUSE COMM COUNCIL	**FLUORIDATOR:**	Prominent
CHEMICAL:	H_2SiF_6 25%	**OPERATOR:**	Steve Mowatt
NATURAL FLUORIDE:	0.21	**TELEPHONE:**	359-6719

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.00	0.91
2. APR 10 - APR 23	1.00	1.01
3. APR 24 - MAY 7	1.00	0.96
4. MAY 8 - MAY 21	0.90	0.97
5. MAY 22 - JUNE 4	1.20	1.07
6. JUNE 5 - JUNE 18	1.50	1.21
7. JUNE 19 - JULY 2	1.20	1.07
8. JULY 3 - JULY 16	1.10	0.93
9. JULY 17 - JULY 30	1.00	0.93
10. JUL 31 - AUG 13	1.00	1.02
11. AUG 14 - AUG 27	1.10	1.07
12. AUG 28 - SEPT 10	1.40	1.15
13. SEPT 11 - SEPT 24	1.20	1.05
14. SEPT 26 - OCT 8	1.20	1.03
15. OCT 9 - OCT 22	1.00	1.02
16. OCT 23 - NOV 5	0.80	0.99
17. NOV 6 - NOV 19	1.00	0.94
18. NOV 20 - DEC 3	1.00	0.97
19. DEC 4 - DEC 17	0.80	0.98
20. DEC 18 - DEC 31	0.80	0.94
21. JAN 1 - JAN 14	0.80	0.98
22. JAN 15 - JAN 28	0.80	0.95
23. JAN 29 - FEB 11	0.80	0.85
24. FEB 12 - FEB 25	0.90	1.01
25. FEB 26 - MAR 10	0.70	0.91
26. MAR 11 - MAR 24	0.60	0.82
AVERAGE TO DATE	0.99	0.99
RANGE - LOW TO DATE - HIGH	0.70 1.50	0.85 1.21
SAMPLES ABOVE LIMITS SAMPLES BELOW LIMITS	2 2	
% OUTSIDE LIMITS TO DATE	15.38%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	NORWAY HOUSE CREE NATION	**FLUORIDATOR:**	
CHEMICAL:	H_2SiF_6 25%	**OPERATOR:**	Larry Duncan
NATURAL FLUORIDE:	< 0.01	**TELEPHONE:**	359-6325

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	NOT AVAIL	NOT AVAIL
2. APR 10 - APR 23	NOT AVAIL	NOT AVAIL
3. APR 24 - MAY 7	NOT AVAIL	NOT AVAIL
4. MAY 8 - MAY 21	NOT AVAIL	NOT AVAIL
5. MAY 22 - JUNE 4	NOT AVAIL	NOT AVAIL
6. JUNE 5 - JUNE 18	NOT AVAIL	NOT AVAIL
7. JUNE 19 - JULY 2	NOT AVAIL	NOT AVAIL
8. JULY 3 - JULY 16	NOT AVAIL	NOT AVAIL
9. JULY 17 - JULY 30	NOT AVAIL	NOT AVAIL
10. JUL 31 - AUG 13	NOT AVAIL	NOT AVAIL
11. AUG 14 - AUG 27	NOT AVAIL	NOT AVAIL
12. AUG 28 - SEPT 10	NOT AVAIL	NOT AVAIL
13. SEPT 11 - SEPT 24	NOT AVAIL	NOT AVAIL
14. SEPT 26 - OCT 8	NOT AVAIL	NOT AVAIL
15. OCT 9 - OCT 22	NOT AVAIL	NOT AVAIL
16. OCT 23 - NOV 5	NOT AVAIL	NOT AVAIL
17. NOV 6 - NOV 19	NOT AVAIL	NOT AVAIL
18. NOV 20 - DEC 3	NOT AVAIL	NOT AVAIL
19. DEC 4 - DEC 17	NOT AVAIL	NOT AVAIL
20. DEC 18 - DEC 31	NOT AVAIL	NOT AVAIL
21. JAN 1 - JAN 14	NOT AVAIL	NOT AVAIL
22. JAN 15 - JAN 28	NOT AVAIL	NOT AVAIL
23. JAN 29 - FEB 11	NOT AVAIL	NOT AVAIL
24. FEB 12 - FEB 25	NOT AVAIL	NOT AVAIL
25. FEB 26 - MAR 10	NOT AVAIL	NOT AVAIL
26. MAR 11 - MAR 24	NOT AVAIL	NOT AVAIL
AVERAGE TO DATE	0.00	0.00
RANGE - LOW TO DATE - HIGH	0.00 0.00	0.00 0.00
SAMPLES ABOVE LIMITS SAMPLES BELOW LIMITS	0 0	
% OUTSIDE LIMITS TO DATE	0.00%	
NUMBER OF SAMPLES TO DATE	0	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	PILOT MOUND	**FLUORIDATOR:**	LMI Saturator
CHEMICAL:	NaF 4%	**OPERATOR:**	Gary Odlum
NATURAL FLUORIDE:	0.21	**TELEPHONE:**	825-2115

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	0.90	1.01
2. APR 10 - APR 23	1.00	1.04
3. APR 24 - MAY 7	1.00	1.08
4. MAY 8 - MAY 21	1.00	1.02
5. MAY 22 - JUNE 4	1.00	1.07
6. JUNE 5 - JUNE 18	1.00	1.08
7. JUNE 19 - JULY 2	1.00	1.09
8. JULY 3 - JULY 16	1.00	1.08
9. JULY 17 - JULY 30	1.00	1.09
10. JUL 31 - AUG 13	0.90	1.01
11. AUG 14 - AUG 27	1.00	1.03
12. AUG 28 - SEPT 10	1.00	1.11
13. SEPT 11 - SEPT 24	0.90	1.09
14. SEPT 26 - OCT 8	1.00	1.09
15. OCT 9 - OCT 22	0.90	1.01
16. OCT 23 - NOV 5	0.90	1.03
17. NOV 6 - NOV 19	0.90	1.05
18. NOV 20 - DEC 3	0.80	1.02
19. DEC 4 - DEC 17	0.80	0.90
20. DEC 18 - DEC 31	0.70	0.93
21. JAN 1 - JAN 14	NOT AVAIL	NOT AVAIL
22. JAN 15 - JAN 28	0.70	0.89
23. JAN 29 - FEB 11	0.60	0.83
24. FEB 12 - FEB 25	1.20	1.30
25. FEB 26 - MAR 10	1.40	1.29
26. MAR 11 - MAR 24	0.80	0.91
AVERAGE TO DATE	0.94	1.04
RANGE - LOW	0.60	0.83
TO DATE - HIGH	1.20	1.30
SAMPLES ABOVE LIMITS	1	
SAMPLES BELOW LIMITS	3	
% OUTSIDE LIMITS TO DATE	16.00%	
NUMBER OF SAMPLES TO DATE	25	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	PINAWA	**FLUORIDATOR:**	Pulse Mate
CHEMICAL:	H_2SiF_6 25%	**OPERATOR:**	Ron McDowall
NATURAL FLUORIDE:	0.08	**TELEPHONE:**	753-2542

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.00	0.95
2. APR 10 - APR 23	1.00	0.96
3. APR 24 - MAY 7	1.00	0.91
4. MAY 8 - MAY 21	1.00	0.85
5. MAY 22 - JUNE 4	1.00	0.80
6. JUNE 5 - JUNE 18	0.90	0.84
7. JUNE 19 - JULY 2	0.90	0.92
8. JULY 3 - JULY 16	1.00	0.91
9. JULY 17 - JULY 30	1.00	0.97
10. JUL 31 - AUG 13	1.00	1.02
11. AUG 14 - AUG 27	1.00	0.96
12. AUG 28 - SEPT 10	0.90	0.93
13. SEPT 11 - SEPT 24	0.90	0.97
14. SEPT 26 - OCT 8	0.90	1.04
15. OCT 9 - OCT 22	0.90	0.97
16. OCT 23 - NOV 5	1.00	0.94
17. NOV 6 - NOV 19	1.00	1.02
18. NOV 20 - DEC 3	1.00	1.04
19. DEC 4 - DEC 17	0.80	1.02
20. DEC 18 - DEC 31	0.90	1.03
21. JAN 1 - JAN 14	0.90	0.93
22. JAN 15 - JAN 28	0.90	1.02
23. JAN 29 - FEB 11	0.80	1.00
24. FEB 12 - FEB 25	0.90	1.02
25. FEB 26 - MAR 10	1.00	1.05
26. MAR 11 - MAR 24	0.90	0.95
AVERAGE TO DATE	0.94	0.96
RANGE - LOW	0.80	0.80
TO DATE - HIGH	1.00	1.05
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	0	
% OUTSIDE LIMITS TO DATE	0.00%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	PORTAGE LA PRAIRIE	**FLUORIDATOR:**	W&T A690
CHEMICAL:	H_2SiF_6 25%	**OPERATOR:**	Doug Campbell
NATURAL FLUORIDE:	0.2	**TELEPHONE:**	239-8373

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.10	1.03
2. APR 10 - APR 23	1.10	1.01
3. APR 24 - MAY 7	1.10	0.89
4. MAY 8 - MAY 21	1.00	0.96
5. MAY 22 - JUNE 4	1.00	0.88
6. JUNE 5 - JUNE 18	1.10	0.96
7. JUNE 19 - JULY 2	1.00	0.87
8. JULY 3 - JULY 16	1.00	0.92
9. JULY 17 - JULY 30	1.00	1.02
10. JUL 31 - AUG 13	1.00	1.02
11. AUG 14 - AUG 27	1.00	0.90
12. AUG 28 - SEPT 10	0.90	1.16
13. SEPT 11 - SEPT 24	0.80	1.01
14. SEPT 26 - OCT 8	0.90	0.92
15. OCT 9 - OCT 22	0.80	0.99
16. OCT 23 - NOV 5	0.60	0.85
17. NOV 6 - NOV 19	1.00	1.01
18. NOV 20 - DEC 3	1.00	0.97
19. DEC 4 - DEC 17	0.80	0.89
20. DEC 18 - DEC 31	0.80	0.96
21. JAN 1 - JAN 14	0.90	0.98
22. JAN 15 - JAN 28	1.00	1.12
23. JAN 29 - FEB 11	1.10	1.12
24. FEB 12 - FEB 25	1.00	1.10
25. FEB 26 - MAR 10	1.10	1.12
26. MAR 11 - MAR 24	1.10	1.17
AVERAGE TO DATE	0.97	0.99
RANGE - LOW	0.60	0.85
TO DATE - HIGH	1.10	1.17
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	1	
% OUTSIDE LIMITS TO DATE	3.85%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	RESTON	**FLUORIDATOR:**	W&T A745
CHEMICAL:	NaF 4%	**OPERATOR:**	Ken Moore
NATURAL FLUORIDE:	0.13	**TELEPHONE:**	877-3862

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.20	1.05
2. APR 10 - APR 23	1.10	1.00
3. APR 24 - MAY 7	0.80	0.95
4. MAY 8 - MAY 21	0.80	0.95
5. MAY 22 - JUNE 4	1.00	0.95
6. JUNE 5 - JUNE 18	0.80	0.95
7. JUNE 19 - JULY 2	1.10	1.05
8. JULY 3 - JULY 16	0.90	1.05
9. JULY 17 - JULY 30	0.80	1.00
10. JUL 31 - AUG 13	1.10	1.05
11. AUG 14 - AUG 27	1.00	1.00
12. AUG 28 - SEPT 10	1.00	1.00
13. SEPT 11 - SEPT 24	1.10	1.05
14. SEPT 26 - OCT 8	1.00	1.05
15. OCT 9 - OCT 22	0.80	1.00
16. OCT 23 - NOV 5	0.80	0.90
17. NOV 6 - NOV 19	1.00	1.00
18. NOV 20 - DEC 3	1.20	1.00
19. DEC 4 - DEC 17	0.90	1.10
20. DEC 18 - DEC 31	1.00	1.05
21. JAN 1 - JAN 14	1.10	1.05
22. JAN 15 - JAN 28	1.00	1.00
23. JAN 29 - FEB 11	1.00	1.00
24. FEB 12 - FEB 25	0.80	0.90
25. FEB 26 - MAR 10	0.90	0.95
26. MAR 11 - MAR 24	0.80	0.95
AVERAGE TO DATE	0.96	1.00
RANGE - LOW TO DATE - HIGH	0.80 1.20	0.90 1.10
SAMPLES ABOVE LIMITS SAMPLES BELOW LIMITS	0 0	
% OUTSIDE LIMITS TO DATE	0.00%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	RIVERS	**FLUORIDATOR:**	LMI Saturator
CHEMICAL:	NaF 4%	**OPERATOR:**	Randy King
NATURAL FLUORIDE:	0.18	**TELEPHONE:**	328-7480

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.00	0.67
2. APR 10 - APR 23	1.10	1.03
3. APR 24 - MAY 7	0.90	0.89
4. MAY 8 - MAY 21	0.90	1.06
5. MAY 22 - JUNE 4	1.00	1.07
6. JUNE 5 - JUNE 18	1.10	1.08
7. JUNE 19 - JULY 2	1.10	1.02
8. JULY 3 - JULY 16	1.10	1.21
9. JULY 17 - JULY 30	1.20	1.31
10. JUL 31 - AUG 13	0.90	1.01
11. AUG 14 - AUG 27	1.10	1.19
12. AUG 28 - SEPT 10	1.00	1.01
13. SEPT 11 - SEPT 24	1.70	1.41
14. SEPT 26 - OCT 8	1.30	0.75
15. OCT 9 - OCT 22	1.00	0.96
16. OCT 23 - NOV 5	1.10	1.13
17. NOV 6 - NOV 19	1.00	1.14
18. NOV 20 - DEC 3	1.20	0.97
19. DEC 4 - DEC 17	1.20	1.25
20. DEC 18 - DEC 31	1.10	0.97
21. JAN 1 - JAN 14	1.10	0.95
22. JAN 15 - JAN 28	1.00	0.90
23. JAN 29 - FEB 11	1.00	0.91
24. FEB 12 - FEB 25	1.10	0.85
25. FEB 26 - MAR 10	1.00	0.98
26. MAR 11 - MAR 24	1.00	1.07
AVERAGE TO DATE	1.08	1.03
RANGE - LOW	0.90	0.67
TO DATE - HIGH	1.70	1.41
SAMPLES ABOVE LIMITS	2	
SAMPLES BELOW LIMITS	0	
% OUTSIDE LIMITS TO DATE	7.69%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	ROBLIN	**FLUORIDATOR:**	W&T A745
CHEMICAL:	NaF 4%	**OPERATOR:**	Glen Reierson
NATURAL FLUORIDE:	0.26	**TELEPHONE:**	937-2377

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	0.90	1.10
2. APR 10 - APR 23	1.00	1.00
3. APR 24 - MAY 7	1.00	1.10
4. MAY 8 - MAY 21	1.00	1.15
5. MAY 22 - JUNE 4	0.80	1.00
6. JUNE 5 - JUNE 18	1.10	1.00
7. JUNE 19 - JULY 2	1.10	1.10
8. JULY 3 - JULY 16	1.10	1.10
9. JULY 17 - JULY 30	1.10	1.10
10. JUL 31 - AUG 13	1.10	1.10
11. AUG 14 - AUG 27	1.10	1.05
12. AUG 28 - SEPT 10	1.00	1.20
13. SEPT 11 - SEPT 24	1.10	1.10
14. SEPT 26 - OCT 8	1.00	1.10
15. OCT 9 - OCT 22	1.10	1.15
16. OCT 23 - NOV 5	1.00	1.05
17. NOV 6 - NOV 19	0.80	1.20
18. NOV 20 - DEC 3	1.00	1.10
19. DEC 4 - DEC 17	1.00	1.10
20. DEC 18 - DEC 31	0.90	1.05
21. JAN 1 - JAN 14	0.90	1.00
22. JAN 15 - JAN 28	0.90	1.10
23. JAN 29 - FEB 11	0.90	1.05
24. FEB 12 - FEB 25	0.90	1.05
25. FEB 26 - MAR 10	0.90	1.05
26. MAR 11 - MAR 24	1.00	1.10
AVERAGE TO DATE	0.99	1.08
RANGE - LOW	0.80	1.00
TO DATE - HIGH	1.10	1.20
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	0	
% OUTSIDE LIMITS TO DATE	0.00%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	ROSSBURN	**FLUORIDATOR:**	W&T A745
CHEMICAL:	NaF 4%	**OPERATOR:**	Nick Antoniw
NATURAL FLUORIDE:	0.1	**TELEPHONE:**	859-2273

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.10	1.00
2. APR 10 - APR 23	1.20	1.00
3. APR 24 - MAY 7	1.00	1.00
4. MAY 8 - MAY 21	0.80	1.00
5. MAY 22 - JUNE 4	0.80	0.90
6. JUNE 5 - JUNE 18	0.80	0.90
7. JUNE 19 - JULY 2	1.20	0.90
8. JULY 3 - JULY 16	1.30	0.90
9. JULY 17 - JULY 30	1.50	1.00
10. JUL 31 - AUG 13	1.30	1.00
11. AUG 14 - AUG 27	0.80	1.00
12. AUG 28 - SEPT 10	0.70	1.00
13. SEPT 11 - SEPT 24	0.80	1.00
14. SEPT 26 - OCT 8	1.10	0.90
15. OCT 9 - OCT 22	1.10	0.90
16. OCT 23 - NOV 5	1.00	0.90
17. NOV 6 - NOV 19	0.90	0.90
18. NOV 20 - DEC 3	1.00	0.90
19. DEC 4 - DEC 17	0.90	0.90
20. DEC 18 - DEC 31	NOT AVAIL	NOT AVAIL
21. JAN 1 - JAN 14	0.90	0.90
22. JAN 15 - JAN 28	1.00	0.90
23. JAN 29 - FEB 11	1.00	1.00
24. FEB 12 - FEB 25	0.90	1.00
25. FEB 26 - MAR 10	0.90	0.90
26. MAR 11 - MAR 24	0.90	0.90
AVERAGE TO DATE	1.00	0.94
RANGE - LOW	0.70	0.90
TO DATE - HIGH	1.50	1.00
SAMPLES ABOVE LIMITS	3	
SAMPLES BELOW LIMITS	1	
% OUTSIDE LIMITS TO DATE	16.00%	
NUMBER OF SAMPLES TO DATE	25	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	RUSSELL	**FLUORIDATOR:**	LMI A151
CHEMICAL:	NaF 4%	**OPERATOR:**	Gerald Best
NATURAL FLUORIDE:	0.21	**TELEPHONE:**	773-3185

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	NOT AVAIL	NOT AVAIL
2. APR 10 - APR 23	0.90	0.87
3. APR 24 - MAY 7	1.00	1.02
4. MAY 8 - MAY 21	0.80	0.89
5. MAY 22 - JUNE 4	0.90	0.88
6. JUNE 5 - JUNE 18	1.00	0.91
7. JUNE 19 - JULY 2	0.90	0.90
8. JULY 3 - JULY 16	1.00	0.97
9. JULY 17 - JULY 30	0.90	0.89
10. JUL 31 - AUG 13	1.00	0.97
11. AUG 14 - AUG 27	1.00	0.88
12. AUG 28 - SEPT 10	1.00	0.94
13. SEPT 11 - SEPT 24	1.10	1.00
14. SEPT 26 - OCT 8	1.30	1.03
15. OCT 9 - OCT 22	1.00	0.99
16. OCT 23 - NOV 5	0.90	0.89
17. NOV 6 - NOV 19	1.00	0.91
18. NOV 20 - DEC 3	1.00	1.05
19. DEC 4 - DEC 17	0.90	1.01
20. DEC 18 - DEC 31	0.90	0.94
21. JAN 1 - JAN 14	0.90	0.85
22. JAN 15 - JAN 28	0.80	0.91
23. JAN 29 - FEB 11	0.80	0.92
24. FEB 12 - FEB 25	0.80	0.89
25. FEB 26 - MAR 10	0.90	0.90
26. MAR 11 - MAR 24	0.80	0.97
AVERAGE TO DATE	0.94	0.94
RANGE - LOW	0.80	0.85
TO DATE - HIGH	1.30	1.05
SAMPLES ABOVE LIMITS	1	
SAMPLES BELOW LIMITS	0	
% OUTSIDE LIMITS TO DATE	4.00%	
NUMBER OF SAMPLES TO DATE	25	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	ST. CLAUDE	**FLUORIDATOR:**	LMI Saturator
CHEMICAL:	NaF 4%	**OPERATOR:**	Henry Tremorin
NATURAL FLUORIDE:	0.45	**TELEPHONE:**	379-2382

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	0.90	0.85
2. APR 10 - APR 23	0.90	0.83
3. APR 24 - MAY 7	1.00	0.90
4. MAY 8 - MAY 21	0.80	0.85
5. MAY 22 - JUNE 4	1.00	0.90
6. JUNE 5 - JUNE 18	1.00	1.00
7. JUNE 19 - JULY 2	1.00	0.95
8. JULY 3 - JULY 16	0.90	0.98
9. JULY 17 - JULY 30	1.10	0.94
10. JUL 31 - AUG 13	NOT AVAIL	NOT AVAIL
11. AUG 14 - AUG 27	1.00	0.90
12. AUG 28 - SEPT 10	0.90	0.90
13. SEPT 11 - SEPT 24	1.00	0.95
14. SEPT 26 - OCT 8	1.00	0.95
15. OCT 9 - OCT 22	1.00	0.90
16. OCT 23 - NOV 5	0.90	0.85
17. NOV 6 - NOV 19	1.00	0.90
18. NOV 20 - DEC 3	1.00	0.92
19. DEC 4 - DEC 17	0.80	0.85
20. DEC 18 - DEC 31	0.80	0.90
21. JAN 1 - JAN 14	0.90	0.90
22. JAN 15 - JAN 28	0.90	1.03
23. JAN 29 - FEB 11	0.80	1.10
24. FEB 12 - FEB 25	1.00	1.09
25. FEB 26 - MAR 10	1.00	1.15
26. MAR 11 - MAR 24	0.90	1.08
AVERAGE TO DATE	0.94	0.94
RANGE - LOW TO DATE - HIGH	0.80 1.10	0.83 1.15
SAMPLES ABOVE LIMITS SAMPLES BELOW LIMITS	0 0	
% OUTSIDE LIMITS TO DATE	0.00%	
NUMBER OF SAMPLES TO DATE	25	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	ST. ROSE DU LAC	**FLUORIDATOR:**	LMI A741
CHEMICAL:	NaF 4%	**OPERATOR:**	Paul Proulx
NATURAL FLUORIDE:	0.12	**TELEPHONE:**	447-2675

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.00	0.95
2. APR 10 - APR 23	0.80	0.82
3. APR 24 - MAY 7	0.80	0.95
4. MAY 8 - MAY 21	0.70	0.89
5. MAY 22 - JUNE 4	0.60	0.54
6. JUNE 5 - JUNE 18	0.80	0.78
7. JUNE 19 - JULY 2	1.00	0.91
8. JULY 3 - JULY 16	1.00	0.87
9. JULY 17 - JULY 30	0.80	0.91
10. JUL 31 - AUG 13	0.50	0.68
11. AUG 14 - AUG 27	1.00	1.08
12. AUG 28 - SEPT 10	0.70	1.10
13. SEPT 11 - SEPT 24	0.70	0.95
14. SEPT 26 - OCT 8	0.80	0.77
15. OCT 9 - OCT 22	0.30	0.48
16. OCT 23 - NOV 5	0.70	0.83
17. NOV 6 - NOV 19	0.70	0.78
18. NOV 20 - DEC 3	0.80	0.81
19. DEC 4 - DEC 17	NOT AVAIL	NOT AVAIL
20. DEC 18 - DEC 31	NOT AVAIL	NOT AVAIL
21. JAN 1 - JAN 14	NOT AVAIL	NOT AVAIL
22. JAN 15 - JAN 28	0.20	0.46
23. JAN 29 - FEB 11	0.40	0.73
24. FEB 12 - FEB 25	0.50	0.95
25. FEB 26 - MAR 10	0.40	0.86
26. MAR 11 - MAR 24	0.30	0.76
AVERAGE TO DATE	0.67	0.82
RANGE - LOW	0.20	0.46
TO DATE - HIGH	1.00	1.10
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	13	
% OUTSIDE LIMITS TO DATE	56.52%	
NUMBER OF SAMPLES TO DATE	23	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	SANDY BAY**	**FLUORIDATOR:**	LMI Saturator
CHEMICAL:	NaF 4%	**OPERATOR:**	Eddie Houle
NATURAL FLUORIDE:	0.22	**TELEPHONE:**	843-2431

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	NOT AVAIL	NOT AVAIL
2. APR 10 - APR 23	NOT AVAIL	NOT AVAIL
3. APR 24 - MAY 7	NOT AVAIL	NOT AVAIL
4. MAY 8 - MAY 21	NOT AVAIL	NOT AVAIL
5. MAY 22 - JUNE 4	NOT AVAIL	NOT AVAIL
6. JUNE 5 - JUNE 18	NOT AVAIL	NOT AVAIL
7. JUNE 19 - JULY 2	NOT AVAIL	NOT AVAIL
8. JULY 3 - JULY 16	NOT AVAIL	NOT AVAIL
9. JULY 17 - JULY 30	NOT AVAIL	NOT AVAIL
10. JUL 31 - AUG 13	NOT AVAIL	NOT AVAIL
11. AUG 14 - AUG 27	NOT AVAIL	NOT AVAIL
12. AUG 28 - SEPT 10	NOT AVAIL	NOT AVAIL
13. SEPT 11 - SEPT 24	NOT AVAIL	NOT AVAIL
14. SEPT 26 - OCT 8	NOT AVAIL	NOT AVAIL
15. OCT 9 - OCT 22	NOT AVAIL	NOT AVAIL
16. OCT 23 - NOV 5	NOT AVAIL	NOT AVAIL
17. NOV 6 - NOV 19	NOT AVAIL	NOT AVAIL
18. NOV 20 - DEC 3	NOT AVAIL	NOT AVAIL
19. DEC 4 - DEC 17	NOT AVAIL	NOT AVAIL
20. DEC 18 - DEC 31	NOT AVAIL	NOT AVAIL
21. JAN 1 - JAN 14	NOT AVAIL	NOT AVAIL
22. JAN 15 - JAN 28	NOT AVAIL	NOT AVAIL
23. JAN 29 - FEB 11	NOT AVAIL	NOT AVAIL
24. FEB 12 - FEB 25	NOT AVAIL	NOT AVAIL
25. FEB 26 - MAR 10	NOT AVAIL	NOT AVAIL
26. MAR 11 - MAR 24	NOT AVAIL	NOT AVAIL
AVERAGE TO DATE	0.00	NOT AVAIL
RANGE - LOW	0.00	0.00
TO DATE - HIGH	0.00	0.00
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	0	
% OUTSIDE LIMITS TO DATE	0.00%	
NUMBER OF SAMPLES TO DATE	0	

**** Back on line May 2000.**

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	SANFORD (R.M. OF MACDONALD)	**FLUORIDATOR:**	W&T
CHEMICAL:	H_2SiF_6 25%	**OPERATOR:**	Claude Collette
NATURAL FLUORIDE:	0.1	**TELEPHONE:**	736-4327

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.20	1.02
2. APR 10 - APR 23	1.10	1.15
3. APR 24 - MAY 7	1.10	1.12
4. MAY 8 - MAY 21	1.00	1.10
5. MAY 22 - JUNE 4	1.10	1.10
6. JUNE 5 - JUNE 18	1.10	1.10
7. JUNE 19 - JULY 2	1.10	1.10
8. JULY 3 - JULY 16	1.20	1.12
9. JULY 17 - JULY 30	1.10	1.10
10. JUL 31 - AUG 13	1.00	1.10
11. AUG 14 - AUG 27	1.10	1.08
12. AUG 28 - SEPT 10	0.90	1.05
13. SEPT 11 - SEPT 24	1.00	1.08
14. SEPT 26 - OCT 8	1.00	1.08
15. OCT 9 - OCT 22	1.10	1.10
16. OCT 23 - NOV 5	1.20	1.02
17. NOV 6 - NOV 19	1.20	1.05
18. NOV 20 - DEC 3	1.10	1.12
19. DEC 4 - DEC 17	1.10	1.06
20. DEC 18 - DEC 31	1.10	1.10
21. JAN 1 - JAN 14	1.10	1.08
22. JAN 15 - JAN 28	1.00	1.09
23. JAN 29 - FEB 11	1.00	1.05
24. FEB 12 - FEB 25	1.00	1.09
25. FEB 26 - MAR 10	1.10	1.10
26. MAR 11 - MAR 24	1.00	1.10
AVERAGE TO DATE	1.08	1.09
RANGE - LOW	0.90	1.02
TO DATE - HIGH	1.20	1.15
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	0	
% OUTSIDE LIMITS TO DATE	0.00%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	SHOAL LAKE	**FLUORIDATOR:**	W&T Saturator
CHEMICAL:	NaF 4%	**OPERATOR:**	John Michasiw
NATURAL FLUORIDE:	0.27	**TELEPHONE:**	759-2522

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	2.60	1.00
2. APR 10 - APR 23	0.50	1.02
3. APR 24 - MAY 7	NOT AVAIL	NOT AVAIL
4. MAY 8 - MAY 21	NOT AVAIL	NOT AVAIL
5. MAY 22 - JUNE 4	NOT AVAIL	NOT AVAIL
6. JUNE 5 - JUNE 18	NOT AVAIL	NOT AVAIL
7. JUNE 19 - JULY 2	NOT AVAIL	NOT AVAIL
8. JULY 3 - JULY 16	NOT AVAIL	NOT AVAIL
9. JULY 17 - JULY 30	NOT AVAIL	NOT AVAIL
10. JUL 31 - AUG 13	NOT AVAIL	NOT AVAIL
11. AUG 14 - AUG 27	NOT AVAIL	NOT AVAIL
12. AUG 28 - SEPT 10	NOT AVAIL	NOT AVAIL
13. SEPT 11 - SEPT 24	NOT AVAIL	NOT AVAIL
14. SEPT 26 - OCT 8	NOT AVAIL	NOT AVAIL
15. OCT 9 - OCT 22	NOT AVAIL	NOT AVAIL
16. OCT 23 - NOV 5	NOT AVAIL	NOT AVAIL
17. NOV 6 - NOV 19	NOT AVAIL	NOT AVAIL
18. NOV 20 - DEC 3	NOT AVAIL	NOT AVAIL
19. DEC 4 - DEC 17	NOT AVAIL	NOT AVAIL
20. DEC 18 - DEC 31	NOT AVAIL	NOT AVAIL
21. JAN 1 - JAN 14	NOT AVAIL	NOT AVAIL
22. JAN 15 - JAN 28	NOT AVAIL	NOT AVAIL
23. JAN 29 - FEB 11	NOT AVAIL	NOT AVAIL
24. FEB 12 - FEB 25	NOT AVAIL	NOT AVAIL
25. FEB 26 - MAR 10	NOT AVAIL	NOT AVAIL
26. MAR 11 - MAR 24	NOT AVAIL	NOT AVAIL
AVERAGE TO DATE	1.55	1.01
RANGE - LOW TO DATE - HIGH	0.50 2.60	1.00 1.02
SAMPLES ABOVE LIMITS SAMPLES BELOW LIMITS	1 1	
% OUTSIDE LIMITS TO DATE	100.00%	
NUMBER OF SAMPLES TO DATE	2	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	SNOW LAKE	**FLUORIDATOR:**	Prom Gamma IV
CHEMICAL:	H_2SiF_6 25%	**OPERATOR:**	Ernie Sorgenson
NATURAL FLUORIDE:	0.1	**TELEPHONE:**	358-7013

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.00	0.90
2. APR 10 - APR 23	0.90	1.00
3. APR 24 - MAY 7	1.00	1.00
4. MAY 8 - MAY 21	1.00	1.10
5. MAY 22 - JUNE 4	1.00	1.00
6. JUNE 5 - JUNE 18	1.00	1.10
7. JUNE 19 - JULY 2	1.00	1.00
8. JULY 3 - JULY 16	1.00	1.00
9. JULY 17 - JULY 30	1.00	1.20
10. JUL 31 - AUG 13	1.00	1.10
11. AUG 14 - AUG 27	0.90	1.00
12. AUG 28 - SEPT 10	0.80	0.85
13. SEPT 11 - SEPT 24	0.90	1.10
14. SEPT 26 - OCT 8	0.80	1.00
15. OCT 9 - OCT 22	0.80	1.00
16. OCT 23 - NOV 5	1.00	1.00
17. NOV 6 - NOV 19	1.00	0.90
18. NOV 20 - DEC 3	1.00	0.90
19. DEC 4 - DEC 17	1.10	1.00
20. DEC 18 - DEC 31	0.80	1.00
21. JAN 1 - JAN 14	0.70	0.90
22. JAN 15 - JAN 28	0.80	1.00
23. JAN 29 - FEB 11	0.80	0.90
24. FEB 12 - FEB 25	1.00	0.90
25. FEB 26 - MAR 10	0.90	0.90
26. MAR 11 - MAR 24	0.90	0.90
AVERAGE TO DATE	0.93	0.99
RANGE - LOW	0.70	0.85
TO DATE - HIGH	1.10	1.20
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	1	
% OUTSIDE LIMITS TO DATE	3.85%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	SOURIS	**FLUORIDATOR:**	LMI Saturator
CHEMICAL:	NaF 4%	**OPERATOR:**	Don Bodin/Brian Bolduc
NATURAL FLUORIDE:	0.19	**TELEPHONE:**	483-3096

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	0.80	0.82
2. APR 10 - APR 23	1.10	0.93
3. APR 24 - MAY 7	0.90	0.90
4. MAY 8 - MAY 21	0.80	0.94
5. MAY 22 - JUNE 4	0.90	1.04
6. JUNE 5 - JUNE 18	0.80	0.85
7. JUNE 19 - JULY 2	0.90	0.97
8. JULY 3 - JULY 16	0.90	0.96
9. JULY 17 - JULY 30	0.80	1.24
10. JUL 31 - AUG 13	0.80	1.29
11. AUG 14 - AUG 27	0.50	0.74
12. AUG 28 - SEPT 10	0.80	1.27
13. SEPT 11 - SEPT 24	0.80	1.24
14. SEPT 26 - OCT 8	0.80	1.01
15. OCT 9 - OCT 22	0.90	1.01
16. OCT 23 - NOV 5	0.80	1.00
17. NOV 6 - NOV 19	0.90	1.09
18. NOV 20 - DEC 3	0.90	1.17
19. DEC 4 - DEC 17	1.00	1.35
20. DEC 18 - DEC 31	0.80	1.10
21. JAN 1 - JAN 14	1.00	1.03
22. JAN 15 - JAN 28	1.00	1.09
23. JAN 29 - FEB 11	0.80	1.09
24. FEB 12 - FEB 25	0.90	1.04
25. FEB 26 - MAR 10	0.70	1.02
26. MAR 11 - MAR 24	1.10	1.10
AVERAGE TO DATE	0.86	1.05
RANGE - LOW	0.50	0.74
TO DATE - HIGH	1.10	1.35
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	2	
% OUTSIDE LIMITS TO DATE	7.69%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	STEINBACH	**FLUORIDATOR:**	Pulsatron
CHEMICAL:	H_2SiF_6 25%	**OPERATOR:**	Don Doyle
NATURAL FLUORIDE:	0.39	**TELEPHONE:**	326-3708

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.10	1.02
2. APR 10 - APR 23	1.10	0.99
3. APR 24 - MAY 7	1.00	0.89
4. MAY 8 - MAY 21	1.00	0.98
5. MAY 22 - JUNE 4	1.00	0.96
6. JUNE 5 - JUNE 18	1.00	1.04
7. JUNE 19 - JULY 2	1.00	1.05
8. JULY 3 - JULY 16	1.00	1.04
9. JULY 17 - JULY 30	1.00	1.00
10. JUL 31 - AUG 13	0.90	0.95
11. AUG 14 - AUG 27	1.10	1.14
12. AUG 28 - SEPT 10	1.20	1.23
13. SEPT 11 - SEPT 24	1.20	1.11
14. SEPT 26 - OCT 8	1.10	1.11
15. OCT 9 - OCT 22	1.10	1.09
16. OCT 23 - NOV 5	0.80	0.92
17. NOV 6 - NOV 19	1.00	1.01
18. NOV 20 - DEC 3	1.10	1.08
19. DEC 4 - DEC 17	1.10	1.08
20. DEC 18 - DEC 31	1.10	1.09
21. JAN 1 - JAN 14	1.00	1.02
22. JAN 15 - JAN 28	1.10	1.14
23. JAN 29 - FEB 11	1.00	1.13
24. FEB 12 - FEB 25	1.10	1.14
25. FEB 26 - MAR 10	1.10	1.08
26. MAR 11 - MAR 24	1.00	0.86
AVERAGE TO DATE	1.05	1.04
RANGE - LOW	0.80	0.86
TO DATE - HIGH	1.20	1.23
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	0	
% OUTSIDE LIMITS TO DATE	0.00%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	STEPHENFIELD	**FLUORIDATOR:**	Prominent
CHEMICAL:	H_2SiF_6 25%	**OPERATOR:**	Dennis Bell
NATURAL FLUORIDE:	0.2	**TELEPHONE:**	828-3434

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	NOT AVAIL	NOT AVAIL
2. APR 10 - APR 23	0.60	0.90
3. APR 24 - MAY 7	0.50	1.20
4. MAY 8 - MAY 21	0.50	1.23
5. MAY 22 - JUNE 4	0.60	1.14
6. JUNE 5 - JUNE 18	0.40	0.66
7. JUNE 19 - JULY 2	0.90	1.09
8. JULY 3 - JULY 16	1.00	1.02
9. JULY 17 - JULY 30	1.00	1.11
10. JUL 31 - AUG 13	1.00	1.11
11. AUG 14 - AUG 27	1.10	1.15
12. AUG 28 - SEPT 10	1.10	1.22
13. SEPT 11 - SEPT 24	1.20	0.87
14. SEPT 26 - OCT 8	1.20	1.16
15. OCT 9 - OCT 22	1.00	1.11
16. OCT 23 - NOV 5	0.80	1.01
17. NOV 6 - NOV 19	0.70	0.90
18. NOV 20 - DEC 3	0.90	1.04
19. DEC 4 - DEC 17	0.80	1.01
20. DEC 18 - DEC 31	0.90	0.97
21. JAN 1 - JAN 14	0.90	0.86
22. JAN 15 - JAN 28	0.90	1.08
23. JAN 29 - FEB 11	0.80	0.87
24. FEB 12 - FEB 25	1.00	1.02
25. FEB 26 - MAR 10	1.00	0.96
26. MAR 11 - MAR 24	0.90	0.98
AVERAGE TO DATE	0.87	1.03
RANGE - LOW TO DATE - HIGH	0.40 1.20	0.66 1.23
SAMPLES ABOVE LIMITS SAMPLES BELOW LIMITS	0 6	
% OUTSIDE LIMITS TO DATE	24.00%	
NUMBER OF SAMPLES TO DATE	25	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	SWAN RIVER	**FLUORIDATOR:**	LMI A741
CHEMICAL:	H_2SiF_6 25%	**OPERATOR:**	Garry Kennedy
NATURAL FLUORIDE:	0.18	**TELEPHONE:**	734-4628

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.10	1.05
2. APR 10 - APR 23	1.10	1.05
3. APR 24 - MAY 7	1.00	1.02
4. MAY 8 - MAY 21	0.80	1.00
5. MAY 22 - JUNE 4	1.10	1.03
6. JUNE 5 - JUNE 18	0.80	1.02
7. JUNE 19 - JULY 2	0.90	1.06
8. JULY 3 - JULY 16	1.30	1.02
9. JULY 17 - JULY 30	1.00	1.02
10. JUL 31 - AUG 13	1.00	1.02
11. AUG 14 - AUG 27	1.00	1.05
12. AUG 28 - SEPT 10	1.00	1.01
13. SEPT 11 - SEPT 24	0.80	0.99
14. SEPT 26 - OCT 8	0.90	1.07
15. OCT 9 - OCT 22	0.80	1.08
16. OCT 23 - NOV 5	1.00	1.00
17. NOV 6 - NOV 19	0.80	1.07
18. NOV 20 - DEC 3	1.00	1.02
19. DEC 4 - DEC 17	0.90	0.93
20. DEC 18 - DEC 31	0.80	0.97
21. JAN 1 - JAN 14	1.20	1.02
22. JAN 15 - JAN 28	1.00	1 00
23. JAN 29 - FEB 11	1.10	1.02
24. FEB 12 - FEB 25	1.00	1.00
25. FEB 26 - MAR 10	1.00	0.89
26. MAR 11 - MAR 24	1.10	0.97
AVERAGE TO DATE	0.98	1.01
RANGE - LOW	0.80	0.89
TO DATE - HIGH	1.30	1.08
SAMPLES ABOVE LIMITS	1	
SAMPLES BELOW LIMITS	0	
% OUTSIDE LIMITS TO DATE	3.85%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	THE PAS	**FLUORIDATOR:**	W&T 32-050
CHEMICAL:	H_2SiF_6 25%	**OPERATOR:**	Ronald Stewart
NATURAL FLUORIDE:	0.15	**TELEPHONE:**	623-6338

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.10	0.90
2. APR 10 - APR 23	1.10	0.80
3. APR 24 - MAY 7	1.00	0.90
4. MAY 8 - MAY 21	1.00	0.80
5. MAY 22 - JUNE 4	0.90	0.80
6. JUNE 5 - JUNE 18	1.00	0.70
7. JUNE 19 - JULY 2	0.90	0.80
8. JULY 3 - JULY 16	1.00	0.50
9. JULY 17 - JULY 30	0.90	1.00
10. JUL 31 - AUG 13	0.90	1.00
11. AUG 14 - AUG 27	1.00	1.10
12. AUG 28 - SEPT 10	0.80	1.10
13. SEPT 11 - SEPT 24	0.90	1.00
14. SEPT 26 - OCT 8	1.00	1.10
15. OCT 9 - OCT 22	1.00	1.00
16. OCT 23 - NOV 5	0.90	1.20
17. NOV 6 - NOV 19	1.00	1.10
18. NOV 20 - DEC 3	1.00	1.10
19. DEC 4 - DEC 17	1.00	1.10
20. DEC 18 - DEC 31	1.00	1.10
21. JAN 1 - JAN 14	1.00	1.10
22. JAN 15 - JAN 28	0.90	1.00
23. JAN 29 - FEB 11	1.00	1.10
24. FEB 12 - FEB 25	0.90	1.10
25. FEB 26 - MAR 10	1.00	1.00
26. MAR 11 - MAR 24	0.90	1.00
AVERAGE TO DATE	0.97	0.98
RANGE - LOW	0.80	0.50
TO DATE - HIGH	1.10	1.20
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	0	
% OUTSIDE LIMITS TO DATE	0.00%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	TREHERNE	**FLUORIDATOR:**	LMI A741
CHEMICAL:	NaF 4%	**OPERATOR:**	Ken Lawrence
NATURAL FLUORIDE:	0.32	**TELEPHONE:**	723-2850

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.00	1.00
2. APR 10 - APR 23	1.00	1.00
3. APR 24 - MAY 7	1.00	0.90
4. MAY 8 - MAY 21	1.00	1.00
5. MAY 22 - JUNE 4	1.00	1.00
6. JUNE 5 - JUNE 18	1.10	1.00
7. JUNE 19 - JULY 2	0.90	1.00
8. JULY 3 - JULY 16	1.00	1.00
9. JULY 17 - JULY 30	1.00	1.00
10. JUL 31 - AUG 13	0.90	0.90
11. AUG 14 - AUG 27	1.20	NOT AVAIL
12. AUG 28 - SEPT 10	0.80	1.00
13. SEPT 11 - SEPT 24	1.00	1.00
14. SEPT 26 - OCT 8	0.90	1.00
15. OCT 9 - OCT 22	1.00	1.00
16. OCT 23 - NOV 5	1.00	0.90
17. NOV 6 - NOV 19	1.10	1.00
18. NOV 20 - DEC 3	1.00	1.00
19. DEC 4 - DEC 17	1.20	1.00
20. DEC 18 - DEC 31	1.00	0.90
21. JAN 1 - JAN 14	1.10	1.00
22. JAN 15 - JAN 28	1.00	1.00
23. JAN 29 - FEB 11	0.90	1.00
24. FEB 12 - FEB 25	1.10	1.00
25. FEB 26 - MAR 10	1.30	0.90
26. MAR 11 - MAR 24	0.90	1.00
AVERAGE TO DATE	1.02	0.98
RANGE - LOW	0.80	0.90
TO DATE - HIGH	1.30	1.00
SAMPLES ABOVE LIMITS	1	
SAMPLES BELOW LIMITS	0	
% OUTSIDE LIMITS TO DATE	3.85%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	VIRDEN	**FLUORIDATOR:**	LMI A751
CHEMICAL:	NaF 4%	**OPERATOR:**	Norm Baxter
NATURAL FLUORIDE:	0.44	**TELEPHONE:**	748-3074

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.10	1.13
2. APR 10 - APR 23	1.20	1.08
3. APR 24 - MAY 7	1.30	0.82
4. MAY 8 - MAY 21	1.30	1.31
5. MAY 22 - JUNE 4	0.90	0.98
6. JUNE 5 - JUNE 18	1.00	0.88
7. JUNE 19 - JULY 2	1.10	1.10
8. JULY 3 - JULY 16	0.90	0.98
9. JULY 17 - JULY 30	1.00	0.87
10. JUL 31 - AUG 13	1.10	0.97
11. AUG 14 - AUG 27	1.00	1.03
12. AUG 28 - SEPT 10	0.90	0.75
13. SEPT 11 - SEPT 24	0.70	0.81
14. SEPT 26 - OCT 8	1.20	1.10
15. OCT 9 - OCT 22	1.00	1.02
16. OCT 23 - NOV 5	1.00	1.07
17. NOV 6 - NOV 19	1.00	1.13
18. NOV 20 - DEC 3	1.00	1.13
19. DEC 4 - DEC 17	1.00	1.23
20. DEC 18 - DEC 31	1.00	1.11
21. JAN 1 - JAN 14	1.10	1.16
22. JAN 15 - JAN 28	1.00	0.88
23. JAN 29 - FEB 11	1.00	0.75
24. FEB 12 - FEB 25	1.10	1.19
25. FEB 26 - MAR 10	0.90	1.14
26. MAR 11 - MAR 24	0.90	1.12
AVERAGE TO DATE	1.03	1.03
RANGE - LOW	0.70	0.75
TO DATE - HIGH	1.30	1.31
SAMPLES ABOVE LIMITS	2	
SAMPLES BELOW LIMITS	1	
% OUTSIDE LIMITS TO DATE	11.54%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	WABOWDEN	**FLUORIDATOR:**	Prominent
CHEMICAL:	H_2SiF_6 25%	**OPERATOR:**	Clarence Bear
NATURAL FLUORIDE:	0.1	**TELEPHONE:**	689-2362

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	0.40	0.50
2. APR 10 - APR 23	1.10	0.96
3. APR 24 - MAY 7	1.20	1.09
4. MAY 8 - MAY 21	1.10	1.15
5. MAY 22 - JUNE 4	0.70	0.80
6. JUNE 5 - JUNE 18	1.00	0.85
7. JUNE 19 - JULY 2	0.90	0.82
8. JULY 3 - JULY 16	1.00	0.92
9. JULY 17 - JULY 30	1.10	0.94
10. JUL 31 - AUG 13	0.80	0.84
11. AUG 14 - AUG 27	0.80	0.85
12. AUG 28 - SEPT 10	0.80	0.92
13. SEPT 11 - SEPT 24	0.90	1.04
14. SEPT 26 - OCT 8	0.90	0.92
15. OCT 9 - OCT 22	1.10	1.01
16. OCT 23 - NOV 5	1.00	1.11
17. NOV 6 - NOV 19	0.80	0.96
18. NOV 20 - DEC 3	1.00	0.88
19. DEC 4 - DEC 17	0.60	0.80
20. DEC 18 - DEC 31	0.60	0.90
21. JAN 1 - JAN 14	0.70	0.90
22. JAN 15 - JAN 28	0.80	1.10
23. JAN 29 - FEB 11	0.80	0.90
24. FEB 12 - FEB 25	0.70	0.60
25. FEB 26 - MAR 10	0.80	0.50
26. MAR 11 - MAR 24	0.90	NOT AVAIL
AVERAGE TO DATE	0.87	0.89
RANGE - LOW TO DATE - HIGH	0.40 1.20	0.50 1.15
SAMPLES ABOVE LIMITS SAMPLES BELOW LIMITS	0 6	
% OUTSIDE LIMITS TO DATE	23.08%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	WINKLER	**FLUORIDATOR:**	Prominent
CHEMICAL:	H_2SiF_6 25%	**OPERATOR:**	John Schmidt
NATURAL FLUORIDE:	0.26	**TELEPHONE:**	325-8711

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	0.90	0.82
2. APR 10 - APR 23	0.90	0.80
3. APR 24 - MAY 7	0.90	0.85
4. MAY 8 - MAY 21	0.80	0.81
5. MAY 22 - JUNE 4	1.00	0.82
6. JUNE 5 - JUNE 18	1.00	1.12
7. JUNE 19 - JULY 2	1.00	0.93
8. JULY 3 - JULY 16	1.10	0.82
9. JULY 17 - JULY 30	1.00	1.00
10. JUL 31 - AUG 13	1.10	0.92
11. AUG 14 - AUG 27	1.20	0.86
12. AUG 28 - SEPT 10	1.00	1.01
13. SEPT 11 - SEPT 24	1.00	0.96
14. SEPT 26 - OCT 8	1.00	0.82
15. OCT 9 - OCT 22	1.00	1.07
16. OCT 23 - NOV 5	1.40	1.29
17. NOV 6 - NOV 19	1.20	0.95
18. NOV 20 - DEC 3	1.10	1.09
19. DEC 4 - DEC 17	0.90	1.06
20. DEC 18 - DEC 31	0.90	0.87
21. JAN 1 - JAN 14	1.10	0.92
22. JAN 15 - JAN 28	1.00	0.82
23. JAN 29 - FEB 11	1.00	1.16
24. FEB 12 - FEB 25	1.00	1.20
25. FEB 26 - MAR 10	1.10	1.05
26. MAR 11 - MAR 24	0.80	0.84
AVERAGE TO DATE	1.02	0.96
RANGE - LOW	0.80	0.80
TO DATE - HIGH	1.40	1.29
SAMPLES ABOVE LIMITS	1	
SAMPLES BELOW LIMITS	0	
% OUTSIDE LIMITS TO DATE	3.85%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	WINNIPEG	**FLUORIDATOR:**	W&T
CHEMICAL:	H_2SiF_6 25%	**OPERATOR:**	Arnold Permut
NATURAL FLUORIDE:	0.1	**TELEPHONE:**	986-4752

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	0.90	NOT AVAIL
2. APR 10 - APR 23	0.90	NOT AVAIL
3. APR 24 - MAY 7	0.90	NOT AVAIL
4. MAY 8 - MAY 21	0.90	NOT AVAIL
5. MAY 22 - JUNE 4	0.90	NOT AVAIL
6. JUNE 5 - JUNE 18	1.00	NOT AVAIL
7. JUNE 19 - JULY 2	0.90	NOT AVAIL
8. JULY 3 - JULY 16	1.00	NOT AVAIL
9. JULY 17 - JULY 30	0.90	NOT AVAIL
10. JUL 31 - AUG 13	0.80	NOT AVAIL
11. AUG 14 - AUG 27	0.80	NOT AVAIL
12. AUG 28 - SEPT 10	0.90	NOT AVAIL
13. SEPT 11 - SEPT 24	0.90	NOT AVAIL
14. SEPT 26 - OCT 8	0.90	NOT AVAIL
15. OCT 9 - OCT 22	1.00	NOT AVAIL
16. OCT 23 - NOV 5	1.00	NOT AVAIL
17. NOV 6 - NOV 19	0.90	NOT AVAIL
18. NOV 20 - DEC 3	1.00	NOT AVAIL
19. DEC 4 - DEC 17	0.90	NOT AVAIL
20. DEC 18 - DEC 31	0.90	NOT AVAIL
21. JAN 1 - JAN 14	1.00	NOT AVAIL
22. JAN 15 - JAN 28	1.00	NOT AVAIL
23. JAN 29 - FEB 11	1.00	NOT AVAIL
24. FEB 12 - FEB 25	1.00	NOT AVAIL
25. FEB 26 - MAR 10	1.10	NOT AVAIL
26. MAR 11 - MAR 24	0.90	NOT AVAIL
AVERAGE TO DATE	0.93	0.00
RANGE - LOW	0.80	0.00
TO DATE - HIGH	1.10	0.00
SAMPLES ABOVE LIMITS	0	
SAMPLES BELOW LIMITS	0	
% OUTSIDE LIMITS TO DATE	0.00%	
NUMBER OF SAMPLES TO DATE	26	

FLUORIDE CONTROL DATA - 1999 / 2000

LOCATION:	WINNIPEGOSIS	**FLUORIDATOR:**	LMI Saturator
CHEMICAL:	NaF 4%	**OPERATOR:**	Ron Pascal
NATURAL FLUORIDE:	0.15	**TELEPHONE:**	656-4345

SAMPLING PERIOD	COMPOSITE (LAB)	COMPOSITE (OPERATOR)
1. MAR 27 - APR 9	1.20	0.86
2. APR 10 - APR 23	1.40	1.10
3. APR 24 - MAY 7	1.10	0.96
4. MAY 8 - MAY 21	1.20	0.91
5. MAY 22 - JUNE 4	1.10	0.95
6. JUNE 5 - JUNE 18	1.10	0.90
7. JUNE 19 - JULY 2	1.10	0.95
8. JULY 3 - JULY 16	1.60	0.94
9. JULY 17 - JULY 30	2.50	NOT AVAIL
10. JUL 31 - AUG 13	NOT AVAIL	NOT AVAIL
11. AUG 14 - AUG 27	NOT AVAIL	NOT AVAIL
12. AUG 28 - SEPT 10	NOT AVAIL	NOT AVAIL
13. SEPT 11 - SEPT 24	NOT AVAIL	NOT AVAIL
14. SEPT 26 - OCT 8	1.00	0.92
15. OCT 9 - OCT 22	1.10	0.99
16. OCT 23 - NOV 5	1.10	1.03
17. NOV 6 - NOV 19	1.00	1.00
18. NOV 20 - DEC 3	NOT AVAIL	NOT AVAIL
19. DEC 4 - DEC 17	NOT AVAIL	NOT AVAIL
20. DEC 18 - DEC 31	NOT AVAIL	NOT AVAIL
21. JAN 1 - JAN 14	NOT AVAIL	NOT AVAIL
22. JAN 15 - JAN 28	NOT AVAIL	NOT AVAIL
23. JAN 29 - FEB 11	NOT AVAIL	NOT AVAIL
24. FEB 12 - FEB 25	NOT AVAIL	NOT AVAIL
25. FEB 26 - MAR 10	NOT AVAIL	NOT AVAIL
26. MAR 11 - MAR 24	NOT AVAIL	NOT AVAIL
AVERAGE TO DATE	1.27	0.96
RANGE - LOW	1.00	0.86
TO DATE - HIGH	2.50	1.10
SAMPLES ABOVE LIMITS	3.00	
SAMPLES BELOW LIMITS	0.00	
% OUTSIDE LIMITS TO DATE	23.08%	
NUMBER OF SAMPLES TO DATE	13.00	